

CHAPTER 52. SNOW MELTING AND FREEZE PROTECTION

THE practicality of melting snow or ice by supplying heat to the exposed surface has been demonstrated in many installations, including sidewalks, roadways, ramps, bridges, access ramps, and parking spaces for the handicapped, and runways. Melting eliminates the need for snow removal by chemical means, provides greater safety for pedestrians and vehicles, and reduces the labor and cost of slush removal. Other advantages include eliminating piled snow, reducing liability, and reducing health risks of manual and mechanized shoveling.

This chapter covers three types of snow-melting and freeze protection systems:

1. Hot fluid circulated in slab-embedded pipes (**hydronic**)
2. Embedded **electric** heater cables or wire
3. Overhead high-intensity **infrared** radiant heating

Detailed information about slab heating can be found in [Chapter 6 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#). More information about infrared heating can be found in Chapter 16 of the same volume.

Components of the system design include (1) heat requirement, (2) slab design, (3) control, and (4) hydronic or electric system design.

1. SNOW-MELTING HEAT FLUX REQUIREMENT

The heat required for snow melting depends on five atmospheric factors: (1) rate of snowfall, (2) snowfall-coincident air dry-bulb temperature, (3) humidity, (4) wind speed near the heated surface, and (5) apparent sky temperature. The dimensions of the snow-melting slab affect heat and mass transfer rates at the surface. Other factors such as back and edge heat losses must be considered in the complete design.

Heat Balance

The processes that establish the heat requirement at the snow-melting surface can be described by terms in the following equation, which is the steady-state energy balance for required total heat flux (heat flow rate per unit surface area) q_o at the upper surface of a snow-melting slab during snowfall.

$$q_o = q_s + q_m + A_r(q_h + q_e) \quad (1)$$

where

q_o = heat flux required at snow-melting surface, W/m^2

q_s = sensible heat flux, W/m^2

q_m = latent heat flux, W/m^2

A_r = snow-free area ratio, dimensionless

q_h = convective and radiative heat flux from snow-free surface, W/m^2

q_e = heat flux of evaporation, W/m^2

Sensible and Latent Heat Fluxes. The sensible heat flux q_s is the heat flux required to raise the temperature of snow falling on the slab to the melting temperature plus, after the snow has melted, to raise the temperature of the liquid to the assigned temperature t_f of the liquid film. The snow is assumed to fall at air temperature t_a . The latent heat flux q_m is the heat flux required to melt the snow. Under steady-state conditions, both q_s and q_m are directly proportional to the snowfall rate s .

Snow-Free Area Ratio. Sensible and latent (melting) heat fluxes occur on the entire slab during snowfall. On the other hand, heat and mass transfer at the slab surface depend on whether there is a snow layer on the surface. Any snow accumulation on the slab acts to partially insulate the surface from heat losses and evaporation. The insulating effect of partial snow cover can be large. Because snow may cover a portion of the slab area, it is convenient to think of the insulating effect in terms of an effective or equivalent snow-covered area A_s , which is perfectly insulated and from which no evaporation and heat transfer occurs. The balance is then considered to be the equivalent snow-free area A_f . This area is assumed to be completely covered with a thin liquid film; therefore, both heat and mass transfer

occur at the maximum rates for the existing environmental conditions. It is convenient to define a dimensionless **snow-free area ratio** A_r :

$$A_r = \frac{A_f}{A_t} \quad (2)$$

where

A_f = equivalent snow-free area, m²

A_s = equivalent snow-covered area, m²

$A_t = A_f + A_s$ = total area, m²

Therefore,

$$0 \leq A_r \leq 1$$

To satisfy $A_r = 1$, the system must melt snow rapidly enough that no accumulation occurs. For $A_r = 0$, the surface is covered with snow of sufficient thickness to prevent heat and evaporation losses. Practical snow-melting systems operate between these limits. Earlier studies indicate that sufficient snow-melting system design information is obtained by considering three values of the free area ratio: 0, 0.5, and 1.0 (Chapman 1952).

Heat Flux because of Surface Convection, Radiation, and Evaporation. Using the snow-free area ratio, appropriate heat and mass transfer relations can be written for the snow-free fraction of the slab A_r . These appear as the third and fourth terms on the right-hand side of [Equation \(1\)](#). On the snow-free surface, maintained at film temperature t_f , heat is transferred to the surroundings and mass is transferred from the evaporating liquid film. Heat flux q_h includes convective losses to the ambient air at temperature t_a and radiative losses to the surroundings, which are at mean radiant temperature T_{MR} . The convection heat transfer coefficient is a function of wind speed and a characteristic dimension of the snow-melting surface. This heat transfer coefficient is also a function of the thermodynamic properties of the air, which vary slightly over the temperature range for various snowfall events. The mean radiant temperature depends on air temperature, relative humidity, cloudiness, cloud altitude, and whether snow is falling.

The heat flux q_e from surface film evaporation is equal to the evaporation rate multiplied by the heat of vaporization. The evaporation rate is driven by the difference in vapor pressure between the wet surface of the snow-melting slab and the ambient air; it is a function of wind speed, a characteristic dimension of the slab, and the thermodynamic properties of the ambient air.

Heat Flux Equations

Sensible Heat Flux. The sensible heat flux q_s is given by the following equation:

$$q_s = \rho_{water} s [c_{p,ice}(t_s - t_a) + c_{p,water}(t_f - t_s)] / c_1 \quad (3)$$

where

$c_{p,ice}$ = specific heat of ice, J/(kg · K)

$c_{p,water}$ = specific heat of water, J/(kg · K)

s = snowfall rate water equivalent, typically assumed to be snowfall rate divided by 10, mm/h

t_a = ambient temperature coincident with snowfall, °C

t_f = liquid film temperature, °C

t_s = melting temperature, °C

ρ_{water} = density of water, kg/m³

$c_1 = 1000 \text{ mm/m} \times 3600 \text{ s/h} = 3.6 \times 10^6$

The density of water, specific heat of ice, and specific heat of water are approximately constant over the temperature range of interest and are evaluated at 0°C. The ambient temperature and snowfall rate are available from weather data. The liquid film temperature is usually taken as 0.56°C.

Melting Heat Flux. The heat flux q_m required to melt the snow is given by the following equation:

$$q_m = \rho_{water} s h_{if} / c_1 \quad (4)$$

where h_{if} = heat of fusion of snow, J/kg.

Convective and Radiative Heat Flux from a Snow-Free Surface. The corresponding heat flux q_h is given by the following equation:

(5)

$$q_h = h_c(t_s - t_a) + \sigma \epsilon_s(T_f^4 - T_{MR}^4)$$

where

h_c = convection heat transfer coefficient for turbulent flow, $W/(m^2 \cdot K)$

T_f = liquid film temperature, K

T_{MR} = mean radiant temperature of surroundings, K

σ = Stefan-Boltzmann constant = $5.670 \times 10^{-8} W/(m^2 \cdot K^4)$

ϵ_s = emittance of surface, dimensionless

The convection heat transfer coefficient over the slab on a plane horizontal surface is given by the following equations (Incropera and DeWitt 1996):

$$h_c = 0.037 \left(\frac{k_{air}}{L} \right) Re_L^{0.8} Pr^{1/3} \quad (6)$$

where

k_{air} = thermal conductivity of air at t_a , $W/(m \cdot K)$

L = characteristic length of slab in direction of wind, m

Pr = Prandtl number for air, taken as $Pr = 0.7$

Re_L = Reynolds number based on characteristic length L

and

$$Re_L = \frac{VL}{\nu_{air}} c_2 \quad (7)$$

where

V = design wind speed near slab surface, km/h

ν_{air} = kinematic viscosity of air, m^2/s

$c_2 = 1000 \text{ m/km} \times 1 \text{ h/3600 s} = 0.278$

Without specific wind data for winter, the extreme wind data in [Chapter 14 of the 2021 ASHRAE Handbook—Fundamentals](#) may be used; note, however, that these wind speeds may not correspond to actual measured data. Furthermore, oversizing systems based on weather extremes should be avoided. If the snow-melting surface is not horizontal, the convection heat transfer coefficient might be different, but in many applications, this difference is negligible.

From [Equations \(6\) and \(7\)](#), the turbulent convection heat transfer coefficient is a function of $L^{-0.2}$. Because of this relationship, shorter snow-melting slabs have higher convective heat transfer coefficients than longer slabs. For design, the shortest dimension should be used (e.g., for a long, narrow driveway or sidewalk, use the width). A snow-melting slab characteristic length $L = 6.1 \text{ m}$ is used in the heat transfer calculations that resulted in [Tables 1, 2, and 3](#).

It is not practical or even sometimes possible to size systems to a snow-free ratio of $A_r = 1$ at a confidence ratio of 100%. Designers should evaluate the critical nature of the area to be treated and size the system for the lowest acceptable heat flux. See [Table 3](#) for guidance on appropriate snow-free area ratios and confidence frequencies, typically used based on application. Under normal atmospheric conditions and given minimum thermal mass coverage (thermal resistance), an upper limit to heat flux is typically bounded by the maximum allowable flow temperature for a pipe embedded in a thermal mass. This is particularly important for concrete, where entering fluid temperatures should not exceed 66°C .

The **mean radiant temperature** T_{MR} in [Equation \(5\)](#) is the equivalent blackbody temperature of the surroundings of the snow-melting slab. Under snowfall conditions, the entire surroundings are approximately at the ambient air temperature (i.e., $T_{MR} = T_a$). When there is no snow precipitation (e.g., during idling and after snowfall operations for $A_r < 1$), the mean radiant temperature is approximated by the following equation:

$$T_{MR} = [T_{cloud}^4 F_{sc} + T_{sky\ clear}^4 (1 - F_{sc})]^{1/4} \quad (8)$$

where

F_{sc} = fraction of radiation exchange that occurs between slab and clouds

T_{cloud} = temperature of clouds, K

$T_{sky\ clear}$ = temperature of clear sky, K

The equivalent blackbody temperature of a clear sky is primarily a function of the ambient air temperature and the water content of the atmosphere. An approximation for the clear sky temperature is given by the following equation, which is a curve fit of data in Ramsey et al. (1982):

$$T_{sky\ clear} = T_a - (1.1058 \times 10^3 - 7.562T_a + 1.333 \times 10^{-2}T_a^2 - 31.292\phi + 14.58\phi^2) \quad (9)$$

where

T_a = ambient temperature, K

ϕ = relative humidity of air at elevation for which typical weather measurements are made, decimal; see energyplus.net/weather for typical meteorological year data by location

Table 1 Frequencies of Snow-Melting Surface Heat Fluxes at Steady-State Conditions*

Location	Snowfall Hours per Year	Snow-Free Area Ratio. A_r	Heat Fluxes Not Exceeded During Indicated Percentage of Snowfall Hours from 1982 to 1993, W/m ²					
			75%	90%	95%	98%	99%	100%
Albany, NY	156	1	282	395	471	588	668	1011
		0.5	189	270	348	436	535	870
		0	118	194	262	376	461	870
Albuquerque, NM	44	1	222	372	529	603	762	1241
		0.5	161	256	304	368	492	723
		0	95	144	191	282	291	611
Amarillo, TX	64	1	358	472	531	668	718	1004
		0.5	223	279	340	390	449	963
		0	76	145	195	282	363	922
Billings, MT	225	1	353	517	589	669	748	1072
		0.5	203	282	322	366	403	566
		0	71	104	142	188	215	355
Bismarck, ND	158	1	476	627	729	867	969	1506
		0.5	263	338	390	466	520	767
		0	50	95	122	189	230	569
Boise, ID	85	1	183	250	314	398	460	640
		0.5	118	165	207	254	280	517
		0	71	97	127	166	195	517
Boston, MA	112	1	303	431	519	636	724	1152
		0.5	207	299	353	470	601	1152
		0	118	235	292	380	544	1152
Buffalo, NY	292	1	364	522	664	873	1040	1799
		0.5	214	305	399	517	594	1227
		0	72	123	174	294	355	781
Burlington, VT	204	1	288	410	485	580	632	1081
		0.5	182	247	289	358	405	1081
		0	72	125	173	247	298	1081
Cheyenne, WY	224	1	375	542	635	721	823	1117
		0.5	219	305	351	415	469	908
		0	52	118	165	241	317	900
Chicago, IL, O'Hare International Airport	124	1	303	396	482	586	740	1643
		0.5	184	242	297	358	431	835
		0	72	120	168	235	262	474
Cleveland, OH	188	1	267	391	494	615	726	1363
		0.5	165	229	291	373	465	741
		0	71	118	149	217	289	711

		1	281	425	525	637	692	1031
Colorado Springs, CO	159	0.5	178	258	311	392	442	687
		0	72	141	191	274	354	521
		1	223	317	389	471	553	1035
Columbus, OH, International Airport	92	0.5	143	190	223	276	298	580
		0	49	95	141	188	195	426
		1	379	550	655	804	913	1307
Des Moines, IA	127	0.5	235	323	377	471	567	977
		0	74	144	216	298	340	729
		1	290	411	491	605	668	1136
Detroit, MI, Metro Airport	153	0.5	178	243	297	371	424	715
		0	71	120	147	235	282	611
		1	388	540	635	752	790	1167
Duluth, MN	238	0.5	225	306	361	413	448	671
		0	71	101	145	213	244	620
		1	212	307	365	423	512	764
Ely, NV	153	0.5	140	208	261	350	407	761
		0	72	143	212	306	353	758
		1	185	347	438	520	539	708
Eugene, OR	18	0.5	149	242	292	375	385	517
		0	95	166	220	321	379	517
		1	287	382	454	549	639	1232
Fairbanks, AK	288	0.5	165	214	247	297	342	630
		0	49	74	99	126	152	273
		1	276	439	542	740	891	1361
Baltimore, MD, BWI Airport	56	0.5	219	342	465	631	751	1162
		0	145	264	374	571	677	964
		1	389	538	610	734	869	1237
Great Falls, MT	233	0.5	224	292	337	407	453	662
		0	53	98	143	190	238	452
		1	300	421	498	613	678	897
Indianapolis, IN	96	0.5	184	254	304	366	391	658
		0	71	118	165	261	312	658
		1	257	340	389	473	537	734
Lexington, KY	50	0.5	153	204	234	270	301	622
		0	50	95	122	145	173	510
		1	312	437	518	649	760	1418
Madison, WI	161	0.5	191	258	310	407	513	773
		0	72	123	189	287	358	611
		1	335	445	542	632	651	671
Memphis, TN	13	0.5	235	303	363	373	410	495
		0	126	235	240	285	307	388
		1	318	425	516	618	654	1359
Milwaukee, WI	161	0.5	194	263	320	404	465	777
		0	73	145	214	309	379	752
Minneapolis-St. Paul, MN	199	1	376	532	608	722	801	1048
		0.5	230	312	360	434	485	904

		0	74	143	192	286	355	773
		1	287	423	518	654	700	1052
New York, NY, JFK Airport	61	0.5	199	294	372	457	517	1024
		0	119	214	270	356	420	995
		1	370	529	677	781	820	882
Oklahoma City, OK	35	0.5	226	320	389	419	453	655
		0	74	145	213	247	355	598
		1	342	468	598	702	817	1145
Omaha, NE	94	0.5	204	281	330	405	425	586
		0	72	121	189	283	315	429
		1	299	439	525	634	717	1376
Peoria, IL	91	0.5	183	260	313	375	410	789
		0	72	119	167	239	291	718
		1	296	406	487	655	777	1038
Philadelphia, PA, International Airport	56	0.5	204	282	353	511	582	842
		0	119	197	249	350	474	711
		1	262	393	502	613	690	1335
Pittsburgh, PA, International Airport	168	0.5	160	238	297	349	406	681
		0	49	97	144	214	244	428
		1	377	530	615	738	837	1349
Portland, ME	157	0.5	239	342	418	530	628	1185
		0	122	212	285	409	479	1021
		1	159	246	321	558	755	934
Portland, OR	15	0.5	122	175	256	360	411	627
		0	72	141	188	246	321	404
		1	438	641	793	984	1107	1519
Rapid City, SD	177	0.5	245	349	416	519	578	773
		0	49	95	121	166	204	564
		1	158	227	280	365	431	604
Reno, NV	63	0.5	115	174	235	331	363	543
		0	72	143	215	288	355	502
		1	165	243	282	346	379	541
Salt Lake City, UT	142	0.5	122	196	240	301	329	541
		0	94	188	235	282	329	541
		1	353	484	577	681	785	1384
Sault Ste. Marie, MI	425	0.5	207	278	327	394	447	753
		0	71	118	148	214	261	594
		1	177	339	434	539	647	664
Seattle, WA	27	0.5	142	226	307	384	420	551
		0	118	165	235	302	386	477
		1	210	308	366	444	500	716
Spokane, WA	144	0.5	141	191	229	266	300	459
		0	72	118	141	170	210	353
		1	348	490	566	677	707	920
Springfield, MO	58	0.5	220	299	368	449	538	757
		0	101	171	238	362	407	715
St. Louis, MO, International Airport	62	1	307	463	537	608	715	1084

Topeka, KS	61	0.5	207	284	330	399	454	847
		0	97	169	214	306	329	611
		1	323	482	607	738	773	919
		0.5	201	291	347	415	438	582
Wichita, KS	60	0	73	122	165	213	264	526
		1	364	515	660	782	900	1027
		0.5	225	302	367	432	481	529
		0	74	143	179	237	260	498

* Heat fluxes are at the snow-melting surface only. See text for calculation of back and edge heat loss fluxes.

Table 2 Mean Sensitivity of Snow-Melting Surface Heat Fluxes to Wind Speed and Slab Length For loads not exceeded during 99% of snowfall hours, 1982 through 1993

Snow-Free Area Ratio, A_r	Ratio of Flux at Stated Condition to Flux at $L = 6.1$ m and $V = V_{met}$				
	$L = 6.1$ m		$L = 1.5$ m		
	$V = 0.5V_{met}$	$V = 2V_{met}$	$V = V_{met}$	$V = 0.5V_{met}$	$V = 2V_{met}$
1	0.7	1.6	1.2	0.8	2.0
0.5	0.8	1.4	1.2	0.9	1.7
0	1.0	1.0	1.0	1.0	1.0

Note: Based on data from U.S. locations.
 L = characteristic length
 V_{met} = meteorological wind speed from NCDC

Table 3 Annual Operating Data at 99% Satisfaction Level of Heat Flux Requirement

City	Time, h/yr Melting Idling			Annual Energy Requirement per Unit Area at Steady-State Conditions,* kWh/m ²					
				System Designed for $A_r = 1$		System Designed for $A_r = 0.5$		System Designed for $A_r = 0$	
				Melting	Idling	Melting	Idling	Melting	Idling
Albany, NY	156	1883	−12.6	32.0	344.5	22.9	343.8	13.8	342.0
Albuquerque, NM	44	954	−8.8	7.7	121.4	5.5	121.4	3.1	120.9
Amarillo, TX	64	1212	−14.0	16.6	197.3	10.5	196.0	4.3	192.9
Billings, MT	225	1800	−23.8	54.6	368.9	33.2	352.6	11.7	288.1
Bismarck, ND	158	2887	−22.6	51.4	655.7	29.4	635.7	7.3	496.8
Boise, ID	85	1611	−14.9	11.2	235.7	7.7	230.3	4.2	215.9
Boston, MA	112	1273	−8.8	24.3	246.0	17.2	245.7	10.1	245.2
Buffalo, NY	292	1779	−15.7	75.5	333.8	46.5	332.8	17.5	321.5
Burlington, VT	204	2215	−15.4	41.6	464.0	26.8	453.6	11.9	424.6
Cheyenne, WY	224	2152	−26.5	63.3	399.7	37.6	396.3	11.9	381.4
Chicago, IL, O'Hare International Airport	124	1854	−15.7	26.8	368.0	17.0	355.7	7.1	316.7
Cleveland, OH	188	1570	−12.9	36.0	272.9	23.2	269.6	10.1	255.0
Colorado Springs, CO	159	1925	−22.6	35.1	306.1	22.4	305.5	9.5	303.6
Columbus, OH, International Airport	92	1429	−10.7	14.4	224.1	9.4	214.5	4.3	195.7
Des Moines, IA	127	1954	−18.8	34.3	404.2	21.4	397.2	8.4	367.6
Detroit, MI, Metro Airport	153	1781	−11.5	32.2	329.3	20.4	322.6	8.5	302.1
Duluth, MN	238	3206	−17.6	65.7	792.3	39.2	746.4	12.5	592.4
Ely, NV	153	2445	−10.4	23.4	445.6	16.6	439.2	9.8	431.8

Eugene, OR	18	481	-9.0	2.7	53.7	2.0	53.6	1.4	53.6
Fairbanks, AK	288	4258	-26.5	62.5	1083.9	36.9	1005.7	11.2	612.6
Baltimore, MD, BWI Airport	56	957	-8.8	12.1	142.3	9.4	142.3	6.7	142.3
Great Falls, MT	233	1907	-26.5	62.1	390.5	37.0	380.4	11.8	320.8
Indianapolis, IN	96	1473	-11.8	20.7	255.3	13.0	247.7	5.4	239.5
Lexington, KY	50	1106	-10.4	8.5	170.6	5.4	164.9	2.3	144.6
Madison, WI	161	2308	-14.9	36.0	471.1	23.0	464.0	9.8	441.9
Memphis, TN	13	473	-10.7	3.2	68.6	2.2	67.9	1.2	66.6
Milwaukee, WI	161	1960	-13.8	36.8	401.3	23.9	391.0	10.8	378.3
Minneapolis-St. Paul, MN	199	2513	-17.6	52.1	580.3	32.6	563.0	12.9	526.5
New York, NY, JFK Airport	61	885	-7.6	13.2	159.8	9.4	159.2	5.7	157.9
Oklahoma City, OK	35	686	-14.0	9.3	129.2	5.8	125.3	2.3	120.8
Omaha, NE	94	1981	-19.0	23.4	392.0	14.5	377.1	5.6	355.5
Peoria, IL	91	1748	-16.5	20.6	329.2	12.9	317.2	5.1	296.6
Philadelphia, PA, International Airport	56	992	-7.6	11.9	159.3	8.4	159.0	5.0	158.3
Pittsburgh, PA, International Airport	168	1514	-12.6	31.6	250.1	20.0	245.2	8.3	228.2
Portland, ME	157	1996	-13.8	42.0	363.5	28.3	363.3	14.6	362.2
Portland, OR	15	329	-5.7	2.0	42.3	1.5	41.6	1.0	40.7
Rapid City, SD	177	2154	-20.4	53.3	433.7	30.7	425.9	8.0	334.6
Reno, NV	63	1436	-8.8	7.2	172.6	5.7	172.5	4.1	172.5
Salt Lake City, UT	142	1578	-8.8	16.6	221.6	13.5	220.5	10.4	220.5
Sault Ste. Marie, MI	425	2731	-17.9	108.0	556.7	65.5	550.4	22.9	490.5
Seattle, WA	27	260	-7.9	3.8	33.1	3.0	33.0	2.1	33.0
Spokane, WA	144	1832	-11.8	21.8	255.5	14.9	249.7	7.9	238.6
Springfield, MO	58	1108	-14.0	13.9	180.3	9.3	179.6	4.7	177.4
St. Louis, MO, International Airport	62	1150	-14.0	14.2	204.0	9.4	200.1	4.6	191.7
Topeka, KS	61	1409	-18.8	14.2	238.4	8.9	233.5	3.6	215.7
Wichita, KS	60	1223	-17.6	15.6	218.2	9.8	213.9	3.9	192.4

Source: Ramsey et al. 1999.

* Does not include back and edge heat losses.

The cloud-covered portion of the sky is assumed to be at T_{cloud} . The height of the clouds may be assumed to be 3000 m. The temperature of the clouds at 3000 m is calculated by subtracting the product of the average lapse rate (rate of decrease of atmospheric temperature with height) and the altitude from the atmospheric temperature T_{atm} . The average lapse rate, determined from the tables of U.S. Standard Atmospheres (COESA 1976), is 6.4 K per 1000 m of elevation (Ramsey et al. 1982). Therefore, for clouds at 3000 m,

$$T_{cloud} = T_{atm} - 19.2 \quad (10)$$

Under most conditions, this method of approximating the temperature of the clouds provides an acceptable estimate. However, when the atmosphere contains a very high water content, the temperature calculated for a clear sky using Equation (9) may be warmer than the cloud temperature estimated using Equation (10). When that condition exists, T_{cloud} is set equal to the calculated clear sky temperature $T_{sky\ clear}$.

Evaporation Heat Flux. The heat flux q_e required to evaporate water from a wet surface is given by

$$q_e = \rho_{dry\ air} h_m (W_f - W_a) h_{fg} \quad (11)$$

where

h_m = mass transfer coefficient, m/s

W_a = humidity ratio of ambient air, kg_{vapor}/kg_{air}

W_f = humidity ratio of saturated air at film surface temperature, $\text{kg}_{\text{vapor}}/\text{kg}_{\text{air}}$

h_{fg} = heat of vaporization (enthalpy difference between saturated water vapor and saturated liquid water), J/kg

$\rho_{\text{dry air}}$ = density of dry air, kg/m^3

Determining the mass transfer coefficient is based on the analogy between heat transfer and mass transfer. Details of the analogy are given in [Chapter 5 of the 2021 ASHRAE Handbook—Fundamentals](#). For external flow where mass transfer occurs at the convective surface and the water vapor component is dilute, the following equation relates the mass transfer coefficient h_m to the heat transfer coefficient h_c [[Equation \(6\)](#)]:

$$h_m = \left(\frac{\text{Pr}}{\text{Sc}} \right)^{2/3} \frac{h_c}{\rho_{\text{dry air}} c_{p,\text{air}}} \quad (12)$$

where Sc = Schmidt number. In applying [Equation \(11\)](#), the values $\text{Pr} = 0.7$ and $\text{Sc} = 0.6$ were used to generate the values in [Tables 1](#) to [4](#).

The humidity ratios both in the atmosphere and at the surface of the water film are calculated using the standard psychrometric relation given in the following equation (from [Chapter 1 of the 2021 ASHRAE Handbook—Fundamentals](#)):

$$W = 0.622 \left(\frac{p_v}{p - p_v} \right) \quad (13)$$

where

p = atmospheric pressure, kPa

p_v = partial pressure of water vapor, kPa

The vapor pressure p_v for calculating W_a is equal to the saturation vapor pressure p_s at the dew-point temperature of the air. Saturated conditions exist at the water film surface. Therefore, the vapor pressure used in calculating W_f is the saturation pressure at the film temperature t_f . The saturation partial pressures of water vapor for temperatures above and below freezing are found in tables of the thermodynamic properties of water at saturation, or can be calculated using appropriate equations. Both are presented in [Chapter 1 of the 2021 ASHRAE Handbook—Fundamentals](#). The atmospheric pressure in [Equation \(13\)](#) is corrected for altitude using the following equation (Kuehn et al. 1998):

The atmospheric pressure in [Equation \(13\)](#) is corrected for altitude using the following equation (Kuehn et al. 1998):

$$p = p_{\text{std}} \left(1 - \frac{Az}{T_o} \right)^{5.265} \quad (14)$$

where

p_{std} = standard atmospheric pressure, kPa

$A = 0.0065 \text{ K/m}$

z = altitude of the location above sea level, m

$T_o = 288.2 \text{ K}$

Altitudes of specific locations are found in [Chapter 14 of the 2021 ASHRAE Handbook—Fundamentals](#).

Heat Flux Calculations. [Equations \(1\)](#) to [\(14\)](#) can be used to determine the required heat fluxes of a snow-melting system. However, calculations must be made for coincident values of snowfall rate, wind speed, ambient temperature, and dew-point temperature (or another measure of humidity). By computing the heat flux for each snowfall hour over a period of several years, a frequency distribution of hourly heat fluxes can be developed. Annual averages or maximums for climatic factors should never be used in sizing a system because they are unlikely to coexist. Finally, it is critical to note that the preceding analysis only describes what is happening at the upper surface of the snow-melting surface. Edge losses and back losses have not been taken into account.

Example 1. During the snowfall that occurred during the 8 pm hour on December 26, 1985, in the Detroit metropolitan area, the following simultaneous conditions existed: air dry-bulb temperature = **-8.3°C** , dew-point temperature = **-10°C** , wind speed = 31.7 km/h, and snowfall rate = 2.54 mm of liquid water equivalent per hour. Assuming $L = 6.1 \text{ m}$, $\text{Pr} = 0.7$, and $\text{Sc} = 0.6$, calculate the surface heat flux q_o for a snow-free area ratio of $A_r = 1.0$. The thermodynamic and transport properties used in the calculation are taken from [Chapter 1](#) and [33 of the 2021 ASHRAE Handbook—Fundamentals](#). The emittance of the wet surface of the heated slab is 0.9.

Solution:

By [Equation \(3\)](#),

$$q_s = 1000 \times \frac{2.54}{3.6 \times 10^6} [2100(0 + 8.3) + 4290(0.56 - 0)] = 14.0 \text{ W/m}^2$$

By [Equation \(4\)](#),

$$q_m = 1000 \times \frac{2.54}{3.6 \times 10^6} \times 334\,000 = 235.6 \text{ W/m}^2$$

By [Equation \(7\)](#),

$$\text{Re}_L = \frac{31.7 \times 6.1 \times 0.278}{1.3 \times 10^{-5}} = 4.13 \times 10^6$$

By [Equation \(6\)](#),

$$h_c = 0.037 \left(\frac{0.0235}{6.1} \right) (4.13 \times 10^6)^{0.8} (0.7)^{1/3} = 24.8 \text{ W/(m}^2 \cdot \text{K)}$$

By [Equation \(5\)](#),

$$\begin{aligned} q_h &= 24.8(0.56 + 8.3) + (5.670 \times 10^{-8})(0.9)(273.7^4 - 264.9^4) \\ &= 258.8 \text{ W/m}^2 \end{aligned}$$

By [Equation \(12\)](#),

$$h_m = \left(\frac{0.7}{0.6} \right)^{2/3} \frac{24.8}{1.33 \times 1005} = 0.0206 \text{ m/s}$$

Obtain the values of the saturation vapor pressures at dew-point temperature -10°C and film temperature 0.56°C from Table 3 in [Chapter 1 of the 2021 ASHRAE Handbook—Fundamentals](#). Then, use [Equation \(13\)](#) to obtain $W_a = 0.00160 \text{ kg}_{\text{vapor}}/\text{kg}_{\text{air}}$ and $W_f = 0.00393 \text{ kg}_{\text{vapor}}/\text{kg}_{\text{air}}$. By [Equation \(11\)](#),

$$q_e = 1.33 \times 0.0206(0.00393 - 0.00160) \times 2499 \times 10^3 = 159.5 \text{ W/m}^2$$

By [Equation \(1\)](#),

$$q_o = 14.0 + 235.6 + 1.0(258.8 + 159.5) = 664 \text{ W/m}^2$$

Note that this is the heat flux needed at the snow-melting surface of the slab. Back and edge losses must be added as discussed in the section on Back and Edge Heat Losses.

Weather Data and Heat Flux Calculation Results

[Table 1](#) shows frequencies of snow-melting loads for 46 cities in the United States (Ramsey et al. 1999). For the calculations, the temperature of the surface of the snow-melting slab was taken to be 0.56°C . Any time the ambient temperature was below 0°C and it was not snowing, it was assumed that the system was idling (i.e., that heat was supplied to the slab so that melting would start immediately when snow began to fall).

Weather data were taken for the years 1982 through 1993. These years were selected because of their completeness of data. The weather data included hourly values of the precipitation amount in equivalent depth of liquid water, precipitation type, ambient dry-bulb and dew-point temperatures, wind speed, and sky cover. All weather elements for 1982 to 1990 were obtained from the *Solar and Meteorological Surface Observation Network 1961 to 1990 (SAMSON)*, Version 1.0 (NCDC 1993). For 1991 to 1993, all weather elements except precipitation were taken from DATSAV2 data obtained from the National Climatic Data Center as described in Colliver et al. (1998). The precipitation data for these years were taken from NCDC's *Hourly Cooperative Dataset* (NCDC 1990).

All wind speeds used were taken directly from the weather data. Wind speed V_{met} is usually measured at height of approximately 10 m. As indicated in the section on Heat Balance, the heat and mass transfer coefficients are functions of a characteristic dimension of the snow-melting slab. The dimension used in generating the values of [Table 1](#) was 6.1 m. Sensitivity of the load to both wind speed and the characteristic dimension is included in [Table 2](#). During snowfall, the sky temperature was taken as equal to the ambient temperature.

The first data column in [Table 1](#) presents the average number of snowfall hours per year for each location. All surface heat fluxes were computed for snow-free area ratios of 1, 0.5, and 0, and the frequencies of snow-melting loads are presented. The frequency indicates the percentage of time that the required snow-melting surface heat flux does not exceed the value in the table for that ratio.



Figure 1. Snow-Melting Surface Heat Fluxes Required to Provide Snow-Free Area Ratio of 0.5 for 90% of Snowfall Hours at That Location

This table is used to design a snow-melting system for a given level of customer satisfaction depending on criticality of function. For example, although a heliport at the rooftop of a hospital may require almost 100% satisfactory operation at a snow-free ratio of 1, a residential driveway may be considered satisfactory at 90% and $A_f = 0.5$ design conditions. To optimize cost, different percentiles may be applied to different sections of the slab. For example, train station slab embark/disembark areas may be designed for a higher percentile and A_f than other sections.

[Figure 1](#) shows the distribution in the United States of snow-melting surface heat fluxes for a snow-free area ratio of 0.5. The values presented satisfy the loads 90% of the snowfall hours for each location (as listed in the 90% column of [Table 1](#)). Local values can be approximated by interpolating between values given on the figure; however, extreme care must be taken because special local climatological conditions exist for many areas (e.g., lake effect snow). Both altitude and geography should be considered in making interpolations. Generally, locations in the northern plains of the United States require the maximum snow-melting heat flux (Chapman 1999).

Table 4 General Guidance for Snow-Free Area Ratio and Frequency Distributions by Application Type

Application Type	Free Area Ratio, A_f	Frequency Distribution, %
Private residential		
Sidewalk, steps	0.5 or 1.0	75 or 90
Driveway	0.0 or 0.5	75 or 90
Steep incline	1.0	90
Multiunit building		
Sidewalk, steps, wheelchair ramp	1.0	95
Parking lot	0.5	75 or 90
Parking ramp	0.5 or 1.0	90 or 95
Commercial building		

Sidewalk, steps, wheelchair ramp	1.0	90 or 95
Parking lot	0.5	75 or 90
Parking ramp	0.5 or 1.0	90 or 95
Public building		
Sidewalk, steps, wheelchair ramp	1.0	95
Parking lot	0.5	90
Parking ramp	1.0	95
K-12 school		
Sidewalk, steps, wheelchair ramp	1.0	90
Parking lot	0.5	90
Parking ramp	1.0	95
Fire/rescue station		
Sidewalk, steps, wheelchair ramp	1.0	95
Parking lot	0.5	95
Parking ramp	1.0	95
Hospital		
Sidewalk, steps, wheelchair ramp	1.0	95
Parking lot	0.5	90 or 95
Parking ramp	1.0	95
MedEvac landing pad	1.0	99
Private landing pad/runway	1.0	90
Car wash aprons	1.0	90

To help avoid excessive sizing of snow-melting systems, [Table 4](#) outlines typical free area ratios and frequency distributions based on application. However, these ratios should be considered general guidance only: each design should be considered on a case-by-case basis to meet the needs of that specific application.

Example for Surface Heat Flux Calculation Using [Table 1](#)

Example 2. Consider the design of a system for Albany, New York, which has an installed heat flux capacity at the top surface of approximately 471 W/m^2 . Based on data in [Table 1](#), this system will keep the surface completely free of snow 95% of the time. Because there are 156 snowfall hours in an average year, this design would have some accumulation of snow approximately 8 h per year (the remaining 5% of the 156 h). This design will also meet the load for more than 98% of the time (i.e., more than 153 of the 156 snowfall hours) at an area ratio of 0.5 and more than 99% of the time for an area ratio of 0. $A_r = 0.5$ means that there is a thin snow layer on part of the slab such that it acts as though half the slab is insulated by a snow layer; $A_r = 0$ means that the snow layer is sufficient to insulate the surface from heat and evaporation losses, but that snow is melting at the base of this layer at the same rate that it is falling on the top of the layer.

Therefore, the results for this system can be interpreted to mean the following (all times are rounded to the nearest hour):

1. (a) For all but 8 h of the year, the slab will be snow free.
2. (b) For the less than 5 h between the 95% and 98% nonexceedance values, there will be a thin build-up of snow on part of the slab.
3. (c) For the less than 2 h between the 98% and 99% nonexceedance values, snow will accumulate on the slab to a thickness at which the snow blanket insulates the slab, but the thickness will not increase beyond that level.
4. (d) For less than 2 h, the system cannot keep up with the snowfall.

An examination of the 100% column shows that to keep up with the snowfall the last 1% of the time, in this case less than 2 h for an average year, would require a system capacity of approximately 870 W/m^2 ; to attempt to keep the slab completely snow free the entire season requires a capacity of 1011 W/m^2 . Based on this interpretation, the

designer and customer must decide the acceptable operating conditions. Note that the heat flux values in this example do not include back or edge losses, which must be added in sizing energy source and heat delivery systems.

Sensitivity of Design Surface Heat Flux to Wind Speed and Surface Size

Some snow-melting systems are in sheltered areas, whereas others may be in locations where surroundings create a wind tunnel effect. Similarly, systems vary in size from the baseline characteristic length of 6.1 m. For example, sidewalks exposed to a crosswind may have a characteristic length on the order of 1.5 m. In such cases, the wind speed will be either less than or greater than the meteorological value V_{met} used in [Table 1](#). To establish the sensitivity of the surface heat flux to wind speed and characteristic length, calculations were performed at combinations of wind speeds $0.5V_{met}$, V_{met} , and $2V_{met}$ and L values of 1.5 m and 6.1 m for area ratios A_r of 1.0 and 0.5. Wind speed and system size do not affect the load values for $A_r = 0$ because the calculations assume that no heat or mass transfer from the surface occurs at this condition. [Table 2](#) presents a set of mean values of multipliers that can be applied to the loads presented in [Table 1](#); these multipliers were established by examining the effect on the 99% nonexceedance values. The ratio of V to V_{met} in a given design problem may be determined from information given in [Chapter 24 of the 2021 ASHRAE Handbook—Fundamentals](#). The closest ratio in [Table 2](#) can then be selected. The designer is cautioned that these are to be used only as guidelines on the effect of wind speed and size variations.

Back and Edge Heat Losses

The surface heat fluxes in [Table 1](#) do not account for heat losses from the back and edges of the slab. Adlam (1950) demonstrated that these back and edge losses may vary from 4 to 50%, depending on factors such as slab construction, operating temperature, ground temperature, and back and edge insulation and exposure. With the construction shown in [Figure 2](#) or [Figure 5](#) and ground temperature of 4.5°C at a depth of 600 mm, back losses in steady state are approximately 20%. Higher losses occur with (1) colder ground, (2) more cover over the slab, or (3) exposed back, such as on bridges or parking decks. Spitler et al. (2002) estimated back losses in transient operation to range between approximately 12 and 29%, depending on storm conditions. Adding a 50 mm insulation layer reduces back losses to approximately 1 to 3% for the same storm conditions. Spitler et al. (2001) include a more detailed report, and provide the source code needed to repeat an analysis for other specific cases.

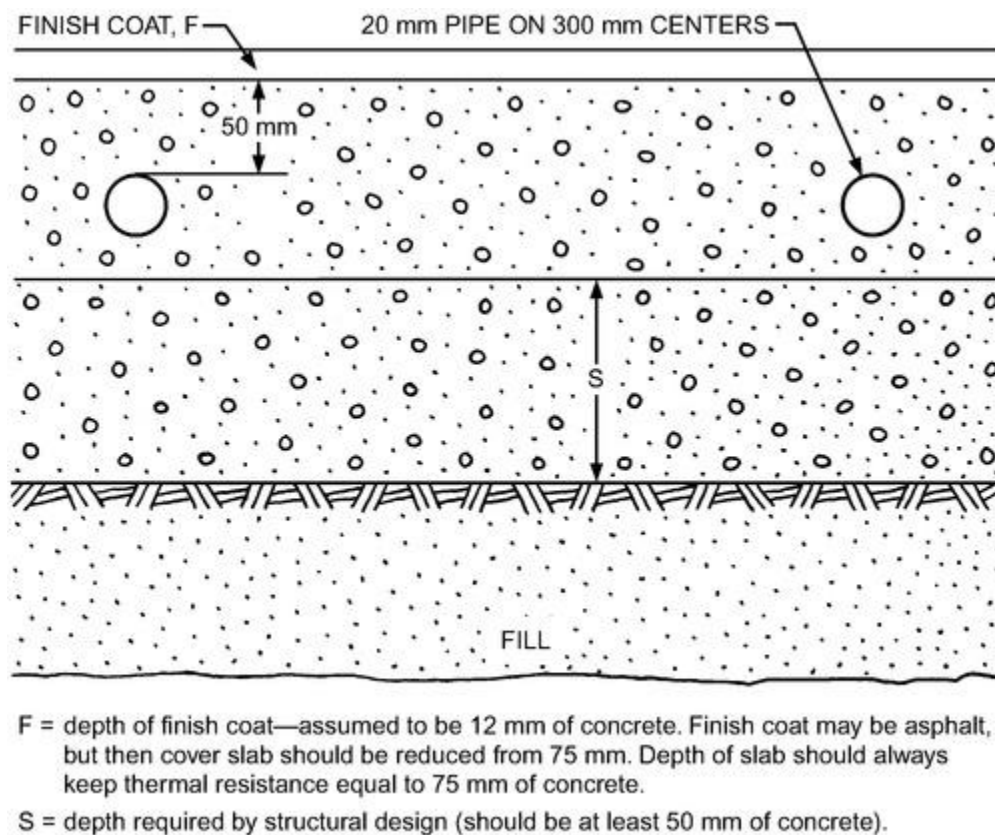


Figure 2. Detail of Typical Hydronic Snow-Melting System

Transient Analysis of System Performance

Determination of snow-melting surface heat fluxes as described in [Equations \(1\) to \(14\)](#) is based on steady-state analysis. Snow-melting systems generally have heating elements embedded in material of significant thermal mass. Transient effects, such as occur when the system is started, may be significant. A transient analysis method was developed by Spitler et al. (2002) and showed that particular storm conditions could change the snow-melting surface heat flux requirement significantly, depending on the precipitation rate at a particular time in the storm. It is therefore difficult to find simple general design rules that account for transient effects. To keep slab surfaces clear from snow during the first hour of the snowstorm, when the system is just starting to operate, heat fluxes up to five times greater than those indicated by steady-state analysis could be required. In general, greater heat input is required for greater spacing and greater depth of the heating elements in the slab; however, because of transient effects, this is not always true.

Transient analysis (Spitler et al. 2002) has also been used to examine back and edge losses. Heat fluxes because of back losses in systems without insulation ranged from 10 to 30% of the surface heat flux, depending primarily on the particular storm data, though higher losses occurred where heating elements were embedded deeper in the slab. In cases where 50 mm of insulation was applied below the slab, back losses were significantly reduced, to 1 to 4%. Although peak losses were reduced, the surface heat fluxes required to melt the snow were not significantly affected by the presence of insulation, because transient effects at the start of system operation drive the peak design surface heat fluxes. Edge losses ranged from 15 to 35% of the heat delivered by the heating element nearest the edge. This may be converted to an approximately equivalent surface heat flux percentage by reducing the snow-melting surface length and width by an amount equal to two-thirds of the heating element spacing in the slab. Then the design surface heat flux may be adjusted by the ratio of the actual snow-melting surface area to the reduced surface area as described here. The effect of edge insulation was found to be similar to that at the back of the slab. Although edge insulation does not reduce the surface heat flux requirement significantly, increased snow accumulation at the edges should be expected.

Annual Operating Data

Annual operating data for the cities in [Table 1](#) are presented in [Table 3](#). Melting and idling hours are summarized in this table along with the energy per unit area needed to operate the system during an average year based on calculations for the years 1982 to 1993. Back and edge heat losses are not included in the energy values in [Table 3](#). Data are presented for snow-free area ratios of 1.0, 0.5, and 0.

The energy per unit area values are based on systems designed to satisfy the loads 99% of the time (i.e., at the levels indicated in the 99% column in [Table 1](#)) for each A_f value. The energy use for each melting hour is taken as either (1) the actual energy required to maintain the surface at 0.56°C or (2) the design output, whichever is less. The design snow-melting energy differs, of course, depending on whether the design is for $A_f = 1.0$, 0.5, or 0; therefore, the annual melting energy differs as well.

The idling hours include all non-snowfall hours when the ambient temperature is below 0°C. The energy consumption for each idling hour is based on either (1) the actual energy required to maintain the surface at 0°C or (2) the design snow-melting energy, whichever is less.

In [Table 3](#), the column labeled "2% Min. Snow Temp." is the temperature below which only 2% of the snowfall hours occur. This table should only be used to predict annual operating costs. Use [Table 1](#) for system sizing.

Annual Operating Cost Example

Example 3. A snow-melting system of 200 m² is to be installed in Chicago. The application is considered critical enough that the system is designed to remain snow free 99% of the time. [Table 3](#) shows that the annual energy requirement to melt the snow is 26.8 kWh/m². Assuming a fossil fuel cost of \$9 per GJ, an electric cost of \$0.07 per kWh, and back loss at 30%, find and compare the annual cost to melt snow with hydronic and electric systems. For the hydronic system, boiler combustion efficiency is 0.85 and energy distribution efficiency is 0.90.

Solution: Operating cost O may be expressed as follows:

$$O = \frac{A_t Q_a F}{[1 - (B/100)](\eta_b \eta_d)} \quad (15)$$

where

O = annual operating cost \$/yr

A_t = total snow-melting area, m²

Q_a = annual snow-melting or idling energy requirement, kWh/m²

F = primary energy cost \$/kWh

B = back heat loss percentage, %

η_b = combustion efficiency of boiler (or COP of a heat pump in heating mode), dimensionless. If a waste energy source is directly used for snow-melting or idling purposes, the combustion efficiency term is neglected.

η_d = energy distribution efficiency, dimensionless (in an electric system, efficiencies may be taken to be 1)

Operating cost for a hydronic system is

$$O = \frac{(200)(26.8)(0.0324)}{\left[1 - \left(\frac{30}{100}\right)\right][(0.85)(0.90)]} = \$324/\text{yr}$$

Operating cost for an electric system is

$$O = \frac{200(26.8)(0.07)}{1 - (30/100)} = \$536/\text{yr}$$

It is desirable to use waste or alternative energy resources to minimize operating costs. If available in large quantities, low-temperature energy resources may replace primary energy resources, because the temperature requirement is generally moderate (Kilkis 1995). Heat pipes may also be used to exploit ground heat (Shirakawa et al. 1985).

Table 5 Thermal Conductivity of Concrete Based on Concrete Density

Thermal Conductivity k_c W/(m · K)	Density, kg/m ³
0.638	1600
0.782	1760
0.953	1920
1.17	2080
1.42	2240
1.75	2400

Source: ACI (2014).

2. SLAB DESIGN

Either concrete or asphalt slabs may be used for snow-melting systems. The thermal conductivity of asphalt is less than that of concrete; pipe or electric cable spacing and required fluid temperatures are thus different. Hot asphalt may damage plastic or electric (except mineral-insulated cable) snow-melting systems unless adequate precautions are taken. Typically, hydronic pipes are embedded in a sand layer below the asphalt before it is laid. For specific recommendations, see the sections on Hydronic System Design and Electric System Design.

Concrete slabs containing hydronic or electric snow-melting apparatus must have a subbase, expansion-contraction joints, reinforcement, and drainage to prevent slab cracking; otherwise, crack-induced shearing or tensile forces could damage the pipe or cable. The pipe or cable must not run through expansion-contraction joints, keyed construction joints, or control joints (dummy grooves); however, the pipe or cable may be run under 3 mm score marks or saw cuts (block and other patterns). Sleeved pipe is allowed to cross expansion joints (see [Figure 3](#)). Control joints must be placed wherever the slab changes size or incline. The maximum distance between control joints for ground-supported slabs should be less than 4.6 m, and the length should be no greater than twice the width, except for ribbon driveways or sidewalks. In ground-supported slabs, most cracking occurs during the early cure. Depending on the amount of water used in the concrete mix, shrinkage during cure may be up to 60 mm per 100 m. If the slab is more than 4.6 m long, the concrete does not have sufficient strength to overcome friction between it and the ground while shrinking during the cure period.

Analysis requiring the thermal conductivity of a concrete slab can be approximated based on the values in [Table 5](#) or from [Equation \(16\)](#). This equation is based on the American Concrete Institute's *Guide to Thermal Properties of Concrete and Masonry Systems* (ACI 2014).

$$k_c = 0.0865 e^{0.00125d} \quad (16)$$

Design of the concrete slab is ultimately the responsibility of the civil engineer. For general information purposes,

- The concrete mix of the top layer should give maximum weatherability
- Compressive strength should be 28 to 34 MPa

- Recommended slump is 75 mm maximum, 50 mm minimum

The pipe or cable may be placed in contact with an existing sound slab (either concrete or asphalt) and then covered as described in the sections on Hydronic System Design and Electric System Design. If there are signs of cracking or heaving, the slab should be replaced. Pipe or cable should not be placed over existing expansion-contraction, control, or construction joints. The finest grade of asphalt is best for the top course; stone diameter should not exceed 10 mm.

A moisture barrier should be placed between any insulation and the fill. If insulation is used, it should be nonhygroscopic. The joints in the barrier should be sealed and the fill made smooth enough to eliminate holes or gaps for moisture transfer. Also, the edges of the barrier should be flashed to the surface of the slab to seal the ends.

Snow-melting systems should have good surface drainage. When the ambient air temperature is 0°C or below, runoff from melting snow freezes immediately after leaving the heated area. Any water that gets under the slab also freezes when the system is shutdown, causing extreme frost heaving. Runoff should be piped away in drains that are heated or below the frost line. If the snow-melting surface is inclined (e.g., a ramp), surface runoff may collect at the lowest point. In addition to effective drainage down the ramp, the adjacent area may require heating to prevent freezing the accumulated runoff.

The area to be protected by the snow-melting system must first be measured and planned. For total snow removal, hydronic or electric heat must cover the entire area. In larger installations, it may be desirable to melt snow and ice from only the most frequently used areas, such as walkways and wheel tracks for trucks and autos. Planning for separate circuits should be considered so that areas within the system can be heated individually, as required.

Where snow-melting apparatus must be run around obstacles (e.g., a storm sewer grate), the pipe or cable spacing should be uniformly reduced. Because some drifting will occur adjacent to walls or vertical surfaces, extra heating capacity should be provided in these areas, and if possible also in the vertical surface. Drainage flowing through the area expected to be drifted tends to wash away some snow.

3. HYDRONIC SYSTEM DESIGN

Hydronic system design includes selection of the following components: (1) heat transfer fluid, (2) piping, (3) fluid heater, (4) pump(s) to circulate the fluid, and (5) controls. With concrete slabs, thermal stress is also a design consideration.

Heat Transfer Fluid

Various fluids, including brines, oils, and glycol/water solutions, are suitable for transferring heat from the fluid heater to the slab. Freeze protection is essential because most systems will not be operated continuously in subfreezing weather. Without freeze protection, power loss or pump failure could cause freeze damage to the piping and slab.

Brine is the least costly heat transfer fluid, but it has a lower specific heat than glycol. Using brine may be discouraged because of the cost of heating equipment that resists its corrosive potential. Although **heat transfer oils** are not corrosive, they are more expensive than brine or glycol, have a lower specific heat and higher viscosity, and are potentially flammable, and as such are no longer used in common practice.

Table 6 Steady-State Surface Heat Fluxes and Average Fluid Temperature for Hydronic Snow-Melting System in [Figure 2](#) (Mean fluid temperature based on 300 mm tube spacing)

s , Rate of Snowfall mm/h	A_r		$t_a = -18^\circ\text{C}$			$t_a = -12^\circ\text{C}$			$t_a = -6.7^\circ\text{C}$			$t_a = -1^\circ\text{C}$		
			Wind Speed V , km/h			Wind Speed V , km/h			Wind Speed V , km/h			Wind Speed V , km/h		
			8	16	24	8	16	24	8	16	24	8	16	24
2.0	1.0	q_o	524	700	858	436	567	686	342	426	501	239	270	298
		t_m	47	62	76	39	51	61	31	38	45	22	24	27
	0.0	q_o	210	210	210	203	203	203	197	197	197	191	191	191
		t_m	19	19	19	18	18	18	18	18	18	17	17	17
4.1	1.0	q_o	734	910	1069	640	771	889	539	623	698	430	461	488
		t_m	65	81	95	57	68	79	48	55	62	38	41	44
	0.0	q_o	420	420	420	407	407	407	394	394	394	381	381	381
		t_m	38	38	38	36	36	36	35	35	35	34	34	34
6.4	1.0	q_o	971	1147	1305	869	1000	1118	761	845	920	645	675	703
		t_m	86	102	115	77	89	99	68	75	82	57	60	62

0.0	q_o	656	656	656	636	636	636	616	616	616	596	596	596
	t_m	58	58	58	57	57	57	55	55	55	53	53	53

Note: Table based on a characteristic pavement length of 6.1 m, standard air pressure, a water film temperature of 0.56°C, and relative humidity of 80%. Heat flux and temperature values in bold underline are not achievable based on material temperature limits of concrete.

A_r = snow-free area ratio

q_o = slab heating flux, W/m²

t_a = atmospheric dry-bulb temperature, °C

t_m = mean fluid temperature based on construction shown in [Figure 2](#), °C

Glycols (ethylene glycol and propylene glycol) are the most popular in snow-melting systems because of their moderate cost, high specific heat, and low viscosity; ease of corrosion control is another advantage. Automotive glycols containing silicates are not recommended because they can cause fouling, pump seal wear, fluid gelation, and reduced heat transfer. The piping should be designed for periodic addition of an inhibitor. Glycols should be tested annually to determine any change in reserve alkalinity and freeze protection. Only inhibitors obtained from the manufacturer of the glycol should be added. Heat exchanger surfaces should be kept below 140°C, which corresponds to about 280 kPa (gage) steam. Temperatures above 150°C accelerate deterioration of the inhibitors.

Because ethylene glycol and petroleum distillates are toxic, no permanent connection should be installed between the snow-melting system and the drinking water supply. Gordon (1950) discusses precautions concerning internal corrosion, flammability, toxicity, cleaning, joints, and hook-up that should be taken during installation of hydronic piping. The properties of brine and glycol are discussed in [Chapter 31 of the 2021 ASHRAE Handbook—Fundamentals](#). The effect of glycol on system performance is detailed in [Chapter 13 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#).

Piping

Historically, piping may have been metal or ethylene-propylene terpolymer (EPDM), though cross-linked polyethylene (PEX) is typically used today.

Chapman (1952) derived the equation for the fluid temperature required to provide an output q_o . For construction as shown in [Figure 2](#), the equation is

$$t_m = 0.089q_o + t_f \quad (17)$$

where t_m = average fluid (antifreeze solution) temperature, °C. [Equation \(16\)](#) applies to {25 mm as well as 20 mm IPS pipe ([Figure 2](#)).

Design information about heated slabs given in [Chapter 6 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#) may be used for all other types of slab construction, pipe spacing, and pipe material. In using these design equations, snow cover or water film on the slab may be treated as surface covers.

Table 7 Typical Dependency of Maximum Heat Flux Deliverable by Plastic Pipes on Pipe Spacing and Concrete Overpour (Mean fluid temperature = 55°C)

Heat Flux, W/m ²	Pipe Spacing on Centers,* mm
440	300
555	230
665	150

* Space pipes 25 mm closer for each 25 mm of concrete cover over 50 mm. Space pipes 50 mm closer for each 25 mm of brick paver and mortar.

For specific conditions or for cities other than those given in [Table 1](#), [Equations \(1\)](#) and [\(16\)](#) are used. [Table 6](#) gives solutions to these equations at a relative humidity of 80%. Splitting the surface heat flux among four components as in [Equation \(1\)](#) also affects the required water temperature; therefore, [Equation \(16\)](#) and [Table 5](#) should be used with caution. [Table 5](#) may also be used to determine successful systems operation conditions. For example, if a system as shown in [Figure 2](#) is designed for 790 W/m², it will satisfy eight severe snow conditions such as −12°C, 4 mm/h, and 16 km/h wind speed (Chapman 1999).

Satisfactory standard practice is to use 20 mm pipe or tube on 230 mm centers, unless the snow-melting surface heat flux is too high. If pumping loads require reduced friction, circuit lengths can be reduced. Piping should be supported by a minimum of 50 mm of concrete above. This requires a 130 mm slab for 20 mm pipe.

Plastic Pipe. Plastic (polyethylene [PE], cross-linked polyethylene [PEX]), or multilayer pipe such as PEX-AL-PEX (a PEX inner and outer layer with a middle layer of aluminum) is popular because of lower material cost, lower installation cost, and corrosion resistance. Typical PEX pipe diameters for snow-melting applications are 16, 19, and 25 mm nominal

diameter (CTS) as per ASTM *Standard* F876. Considerations when using plastic pipe include stress crack resistance, temperature limitations, and thermal conductivity. Heat transfer oils should not be used with plastic pipe.

Plastic pipe is furnished in coils. Smaller pipe can be bent to form a variety of heating panel designs without elbows or joints. Mechanical compression connections can be used to connect heating panel pipe to the larger supply and return piping leading to the pump and fluid heater, typically supplied by a distribution manifold where circuits can be balanced according to differences in length and associated pressure drop. PE pipe may be fused using appropriate fittings and fusion equipment. Fusion joining eliminates metallic components and thus the possibility of corrosion in the piping; however, it requires considerable installation training.

When plastic pipe is used, the system must be designed so that the fluid temperature required will not damage the pipe. If a design requires a temperature above the tolerance of plastic pipe, the delivered heat flux will never meet design requirements. The PE temperature limit is typically 60°C. For PEX, the temperature is 93°C (up to 550 kPa) sustained fluid temperature, or 82°C (up to 690 kPa). However, the entering water temperature for the concrete is typically the constraint: it usually must be less than 65°C, or the value specified in the relevant standard (e.g., CSA *Standard* A23). A potential solution to temperature limitations is to decrease the pipe spacing or depth. Closer pipe spacing also helps eliminate striping of snow (unmelted portions between adjacent pipe projections on the surface). Adlam (1950) addresses the parameter of pipe size and the effect of pipe spacing on heat output. A typical solution is summarized in [Table 7](#), which shows a way of designing pipe spacing according to flux requirements.

Oxygen permeation (see DIN *Standard* 4726 for typical permeation values) through plastic pipes may lead to corrosion on metal surfaces in the entire system unless plastic pipes are equipped with an oxygen barrier layer. Otherwise, either a heat exchanger must separate the plastic pipe circuitry from the rest of the system or corrosion-inhibiting additives must be used in the entire hydronic system.

Pipe Installation. It is good design practice to avoid passing any embedded piping through a concrete expansion joint; otherwise, the pipe may be stressed and possibly ruptured. [Figure 3](#) shows a method of protecting piping that must pass through a concrete expansion joint from stress under normal conditions.

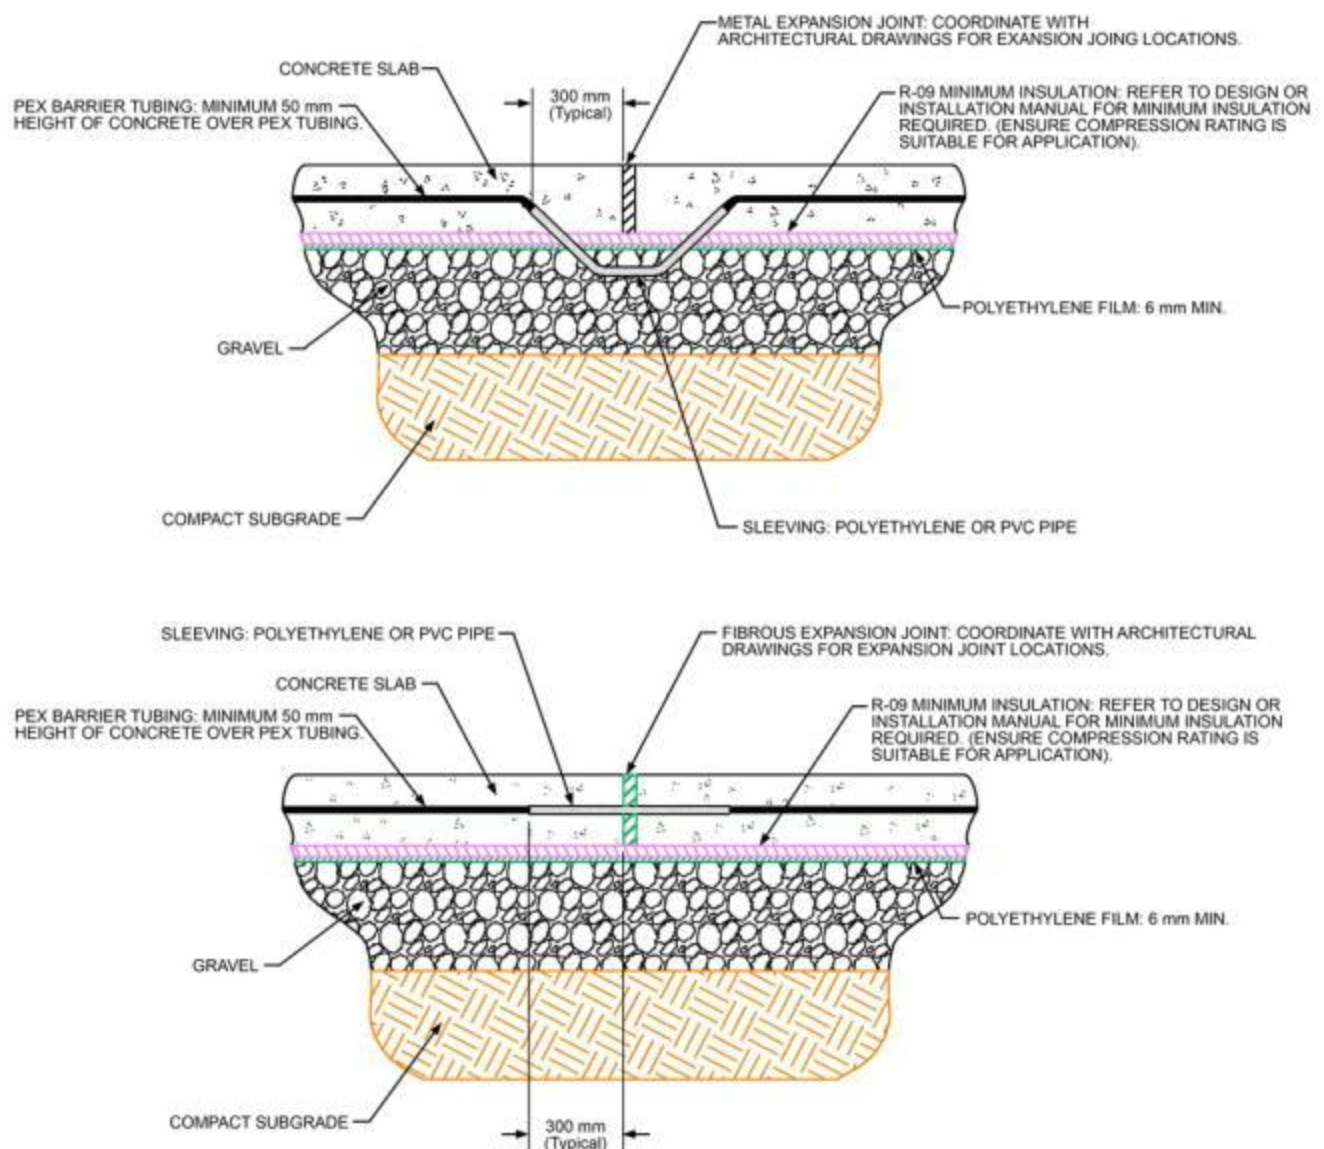


Figure 3. Piping Details for Concrete Construction for Metal and Fibrous Expansion Joints

After pipe installation, but before slab installation, all piping should be air-tested to about 700 kPa (gage). This pressure should be maintained until all welds and connections have been checked for leaks. Isolate the air pressure test to manifold and piping, because boilers or other energy-converting, accumulating, or conditioning equipment may have lower pressure test limits. For example, boilers normally have an air test capability of 235 kPa. Testing should not be done with water because (1) small leaks may not be observed during slab installation; (2) water leaks may damage the concrete during installation; (3) the system may freeze before antifreeze is added; and (4) it is difficult to add antifreeze when the system is filled with water.

Air Control. Because introducing air causes deterioration of the antifreeze, the piping should not be vented to the atmosphere. It should be divided into smaller zones to facilitate filling and allow isolation when service is necessary.

Air can be eliminated from piping during initial filling by pumping the antifreeze from an open container into isolated zones of the piping. A properly sized pump and piping system that maintains adequate fluid velocity, together with an air separator and expansion tank, will keep air from entering the system during operation.

A strainer, sediment trap, or other means for cleaning the piping system may be provided. It should be placed in the return line ahead of the heat exchanger and must be cleaned frequently during initial system operation to remove scale and sludge. A strainer should be checked and cleaned, if necessary, at the start of and periodically during each snow-melting season.

An ASME safety relief valve of adequate capacity should be installed on a closed system.

Fluid Heater

The heat transfer fluid can be heated using any of a variety of energy sources, depending on availability. A fluid heater can use steam, hot water, gas, oil, or electricity. In some applications, heat may be available from secondary sources, such as engine generators, condensate, and other waste heat sources. Other low-temperature waste, or alternative energy resources may also be used with or without heat pumps or heat pipes. In a district heating system, the snow-melting system may be tied to the return piping of the district, which increases the overall temperature drop in the district heating system (Brown 1999).

Design of the fluid heater should follow standard practice, with adjustments for the film coefficient. Consideration should be given to flue gas condensation and thermal shock in boilers because of low fluid temperatures. Bypass flow and temperature controls may be necessary to maintain recommended boiler temperatures. Boilers should be derated for high-altitude applications.

Thermal Stress

Chapman (1955) and Kilgis (1994) discuss the problems of thermal stress in a concrete slab. In general, thermal stress will cause no problems if the following installation and operation rules are observed:

- Minimize the temperature difference between the fluid and the slab surface by maintaining (1) close pipe spacing (see [Figure 2](#)), (2) a low temperature differential in the fluid (less than 17 K), and (3) continuous operation (if economically feasible). According to Shirakawa et al. (1985), the temperature difference between the slab surface and the heating element skin should not exceed 39 K during operation.
- Install pipe within about 50 mm of the surface.
- Use reinforcing steel designed for thermal stress if high structural loads are expected (e.g., on highways).

Thermal shock to the slab may occur if heated fluid is introduced from a large source of residual heat such as a storage tank, a large piping system, or another snow-melting area. The slab should be brought up to temperature by maintaining the fluid temperature differential at less than 20 K.

Heated concrete slab creates temperature gradients, which in turn causes tensile stress. When tensile stress exceeds the concrete's tensile strength, thermal cracking results. [Figure 4](#) shows the maximum allowable temperature difference based on properties of concrete calculated per ACI (2014) guidelines.

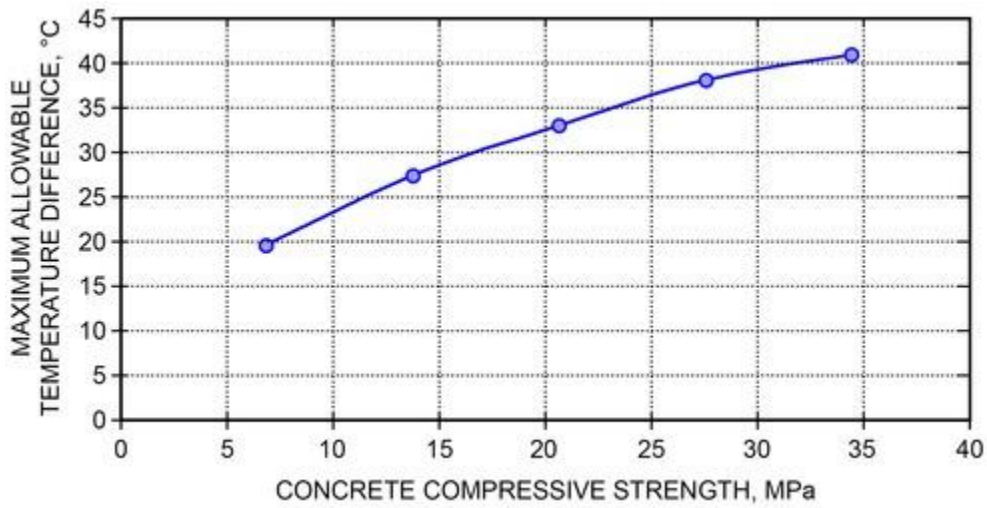


Figure 4. Relationship Between Concrete Compressive Strength and Maximum Allowable Temperature Difference

In a heated slab, the largest temperature difference occurs between the heating element skin t_d and slab surface t_{max} . The temperature difference $(t_d - t_{max})$ must be less than the maximum allowable temperature difference to prevent concrete damage. The designer should apply a safety factor to further ensure the integrity of the concrete slab and system design. Ultimately, the design of the concrete slab should be the responsibility of the civil engineer of record.

$$(t_{max} - t_d) < \nabla T(\text{MATD}) \quad (18)$$

$$(k_e \cdot t_{total}) = 2 \cdot \left[\sum_{i=1}^{n_i} (k_i \cdot s_i) + k \cdot L \right] \quad (19)$$

$$(t_p - t_a) = \frac{q_f}{h_f} \quad (20)$$

$$m = \left(\frac{h_f}{k_e \cdot t_{total}} \right)^{1/2} \quad (21)$$

$$\eta = \frac{\tanh(m \cdot W)}{(m \cdot W)} \quad \{A_r > 0\} \quad (22)$$

$$R_{co} = \sum_{i=1}^{n_i} (k_i \cdot s_i) \quad (23)$$

$$t_{max} = t_a + \frac{q_f / h_f \cdot M}{2 \cdot W \cdot \eta + D_o} \quad (24)$$

$$t_d = t_{max} + q_o \left(R_{co} + \frac{L - D_o/2}{k} \right) \quad (25)$$

where

A_r = snow-free ratio, dimensionless

D_o = outside diameter of heating element, m

h_f = coefficient of surface heat loss intensity, $\text{W}/(\text{m}^2 \cdot \text{K})$

k = thermal conductivity of material in which heating element is embedded, $\text{W}/(\text{m}^2 \cdot \text{K})$

k_e = equivalent thermal conductivity of composite slab for lateral heat diffusion, $\text{W}/(\text{m}^2 \cdot \text{K})$

k_{film} = thermal conductivity of film of melted snow, $W/(m^2 \cdot K)$

k_h = thermal conductivity of heating element, $W/(m^2 \cdot K)$

k_i = thermal conductivity of each material layer on top of slab, $W/(m^2 \cdot K)$

L = distance from center of heating element to surface of slab, m

M = embedded heating element spacing on centers, mm

m = fin coefficient, m^{-1}

n_i = number of layers above heated slab, dimensionless

q_e = evaporative heat loss intensity during snowfall, W/m^2

q_f = total surface heat loss intensity, W/m^2

q_h = radiation and convection heat loss intensity during snowfall, W/m^2

q_o = design heat load intensity, W/m^2

R_{co} = total thermal resistance of layers above slab, $(m^2 \cdot K)/W$

S_i = thickness of each material layer on top of slab, m

t_a = air temperature at snowfall, $^{\circ}C$

t_d = heating element surface temperature, $^{\circ}C$

t_{max} = maximum slab surface temperature, $^{\circ}C$

∇T = temperature gradient, dimensionless

t_{total} = distance from center of heating element to surface, including thickness of water film, m

W = half of net spacing between adjacent heating elements $(M - D_o)/2$, m

η = fin efficiency of composite fin, dimensionless

Example 4. Determine the maximum temperature difference for a 200 mm concrete slab with the following properties: compressive strength $\sim 34\,500$ kPa; density: ~ 2400 kg/m³; conductivity $k_c \sim 1.75$ W/(m \cdot K). Pipe outside diameter is 19 mm, pipe spacing 305 mm on center; pipe depth 50 mm below slab.

Parameters from Example 1:

$$t_a = -8.3^{\circ}C$$

$$t_p = 0.56^{\circ}C$$

$$k_{film} = 0.54 \text{ W/(m} \cdot \text{K)}$$

$$q_h = 258.8 \text{ W/m}^2$$

$$q_e = 162 \text{ W/m}^2$$

$$q_f = 425 \text{ W/m}^2$$

$$q_o = 675 \text{ W/m}^2$$

$$D_o = 0.019 \text{ m}$$

$$L = 0.06 \text{ m}$$

$$M = 0.3048 \text{ m}$$

$$W = (0.3048 - 0.019)/2 = 0.1429 \text{ m}$$

$$(k_e T_{total}) = 0.257 \text{ W/K, by Equation (19)}$$

$$h_f = 47.7 \text{ W/(m}^2 \cdot \text{K)}, \text{ by Equation (20)}$$

$$m = 13.65 \text{ m}^{-1}, \text{ by Equation (21)}$$

$$\eta = 0.49, \text{ by Equation (22)}$$

$$R_{co} = [0.019 \text{ m}/k_{film} + (0.0127 \text{ m}/k_c)] = 0.0102 \text{ (K} \cdot \text{m}^2)/\text{W; by Equation (23)}$$

$$t_{max} = 8.7^{\circ}C, \text{ by Equation (24)}$$

$$t_d = 35.2^{\circ}C, \text{ by Equation (25)}$$

$$(t_d - t_{max}) = (35.2 - 8.7) = 26.5 \text{ K}$$

The maximum allowable temperature difference for concrete with a 34 500 kPa compressive strength is about 40 K; therefore, $(t_d - t_{max})$ is well within concrete's strength.

4. ELECTRIC SYSTEM DESIGN

Snow-melting systems using electricity as an energy source have heating elements in the form of (1) mineral-insulated (MI) cable, (2) self-regulating cable, (3) constant-wattage cable, or (4) high-intensity infrared heaters.

Heat Flux

The basic load calculations for electric systems are the same as presented in the section on Snow-Melting Heat Flux Requirement. However, because electric system output is determined by the resistance installed and the voltage impressed, it cannot be altered by fluid flow rates or temperatures. Consequently, neither safety factors nor marginal capacity systems are design considerations.

Heat flux within a slab can be varied by altering the heating cable spacing to compensate for anticipated drift areas or other high-heat-loss areas. Power density should not exceed 1300 W/m² (NFPA *Standard* 70).

Electrical Equipment

Installation and design of electric snow-melting systems is governed by Article 426 of the *National Electrical Code*[®] (NEC, or NFPA *Standard* 70), which requires that each electric snow-melting circuit (except mineral-insulated, metal-sheathed cable embedded in a noncombustible medium) be provided with a ground fault protection device. An equipment protection device (EPD) with a trip level of 30 mA should be used to reduce the likelihood of nuisance tripping.

Double-pole, single-throw switches or tandem circuit breakers should be used to open both sides of the line. The switchgear may be in any protected, convenient location. It is also advisable to include a pilot lamp on the load side of each switch so that there is a visual indication when the system is energized.

Junction boxes located at grade level are susceptible to water ingress. Weatherproof junction boxes installed above grade should be used for terminations.

The power supply conduit is run underground, outside the slab, or in a prepared base. With concrete slab, this conduit should be installed before the reinforcing mesh.

Mineral-Insulated Cable

Mineral-insulated (MI) heating cable is a magnesium oxide (MgO)-filled, die-drawn cable with one or two copper or copper alloy conductors and a seamless copper or stainless steel alloy sheath. Copper sheath versions are usually protected from salts and other chemicals by a polyvinyl chloride (PVC) or high-density polyethylene jacket.

Cable Layout. To determine the characteristics of the MI heating cable needed for a specific area, the following must be known:

- Heated area size
- Power density required
- Voltage(s) available
- Approximate cable length needed

To find the approximate MI cable length, estimate 6 m of cable per square metre of concrete. This corresponds to 150 mm on-center spacing. Actual cable spacing will vary between 75 and 230 mm for proper power density.

Cable spacing is dictated primarily by the heat-conducting ability of the material in which the cable is embedded. Concrete has a higher heat transmission coefficient than asphalt, permitting wider cable spacing. The following is a procedure to select the proper MI heating cable:

1. Determine total power required for each heated slab.

$$W = Aw \quad (26)$$

2. Determine total resistance.

$$R = E^2/W \quad (27)$$

3. Calculate cable resistance per metre.

$$r_1 = R/L_1 \quad (28)$$

where

W = total power needed, W

A = heated area of each heated slab, m²

w = required power density input, W/m²

R = total resistance of cable, Ω

E = voltage available, V

r_1 = calculated cable resistance, Ω per metre of cable

L_1 = estimated cable length, m

L = actual cable length needed, m

r = actual cable resistance, Ω /m

M = cable on-center spacing, mm

I = total current per MI cable, A

Commercially available mineral-insulated heating cables have actual resistance values (if there are two conductors, the value is the total of the two resistances) ranging from 0.005 to 2 Ω /m. Manufacturing tolerances are $\pm 10\%$ on these values. MI cables are die-drawn, with the internal conductor drawn to size indirectly by pressures transmitted through the mineral insulation.

4. From manufacturers' literature, choose a cable with a resistance r closest to the calculated r_1 . Note that r is generally listed at ambient room temperature. At the specific temperature, r may drift from the listed value. It may be necessary to make a correction as described in [Chapter 6 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#).
5. Determine the actual cable length needed to give the wattage desired.

$$L = R/r \quad (29)$$

6. Determine cable spacing within the heated area.

$$M = 1000A/L \quad (30)$$

For optimum performance, heating cable spacing should be within the following limits: in concrete, 75 to 230 mm; in asphalt, 75 to 150 mm.

Because the manufacturing tolerance on cable length is $\pm 1\%$, and installation tolerances on cable spacing must be compatible with field conditions, it is usually necessary to adjust the installed cable as the end of the heating cable is rolled out. Cable spacing in the last several passes may have to be altered to give uniform heat distribution.

The installed cable within the heated areas follows a serpentine path originating from a corner of the heated area ([Figure 5](#)). As heat is conducted evenly from all sides of the heating cable, cables in a concrete slab can be run within half the spacing dimension of the perimeter of the heated area.

7. Determine the current required for the cable.

$$I = E/R, \text{ or } I = W/E \quad (31)$$

8. Choose cold-lead cable as dictated by typical design guidelines and local electrical codes (see [Table 8](#)).

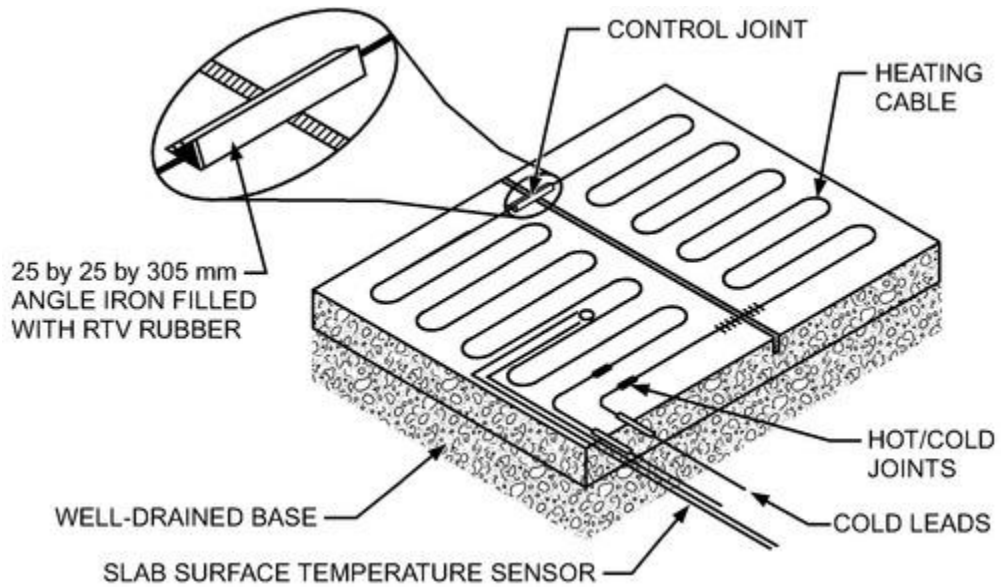


Figure 5. Typical Mineral Insulated Heating Cable Installation in Concrete Slab

Cold-Lead Cable. Every MI heating cable is factory-fabricated with a non-heat-generating cold-lead cable attached. The cold-lead cable must be long enough to reach a dry location for termination and of sufficient wire gage to comply with local and *NEC* standards. The *NEC* requires a minimum cold-lead length of 180 mm within the junction box. MI cable junction boxes must be located such that the box remains dry and at least 0.9 m of cold-lead cable is available at the end for any future service ([Figure 5](#)). Preferred junction box locations are indoors; on the side of a building, utility pole, or wall; or inside a manhole on the wall. Boxes should have a hole in the bottom to drain condensation. Outdoor boxes should be completely watertight except for the condensation drain hole. Where junction boxes are mounted below grade, the cable end seals must be coated with an epoxy to prevent moisture entry. Cable end seals should extend into the junction box far enough to allow the end seal to be removed if necessary.

Table 8 Mineral-Insulated Cold-Lead Cables (Maximum 600 V)

Single-Conductor Cable		Two-Conductor Cable	
Current Capacity, A	American Wire Gage	Current Capacity, A	American Wire Gage
35	14	25	14/2
40	12	30	12/2
55	10	40	10/2
80	8	55	8/2
105	6	75	6/2
140	4	95	4/2
165	3		
190	2		
220	1		

Source: *National Electrical Code*[®] (NFPA Standard 70).

Although MgO, the insulation in MI cable, is hygroscopic, the only vulnerable part of the cable is the end seal. However, should moisture penetrate the seal, it can easily be detected with a megohmmeter and driven out by applying a torch 0.6 to 0.9 m from the end and working the flame toward the end.

Installation. When MI electric heating cable is installed in a concrete slab, the slab may be poured in one or two layers. In single-pour application, the cable is hooked on top of the reinforcing mesh before the pour is started. In two-layer application, the cable is laid on top of the bottom structural slab and embedded in the finish layer. For a proper bond between layers, the finish slab should be poured within 24 h of the bottom slab, and a bonding grout should be applied. The finish slab should be at least 50 mm thick. Cable should not run through expansion, control, or dummy joints (score or groove). If the cable must cross such a joint, it should cross the joint as few times as possible and be protected at the point of crossing with RTV rubber and a 25 by 25 by 300 mm angle iron as shown in [Figure 5](#).

The cable is uncoiled from reels and laid as described in the section on Cable Layout. Prepunched copper or stainless steel spacing strips are often nailed to the lower slab for uniform spacing.

A high-density polyethylene (HDPE) or polyvinyl chloride (PVC) jacket is extruded by the manufacturer over the cable to protect from chemical damage and to protect the cable from physical damage without adding excessive thermal insulation.

If unjacketed MI cables are used, calcium chloride or other chloride additives should not be added to a concrete mix in winter because chlorides are destructive to copper. Cinder or slag fill under snow-melting slabs should also be avoided. The cold-lead cable should exit the slab underground in suitable conduits to prevent physical and chemical damage.

In asphalt slabs, the MI cable is fixed in place on top of the base pour with prepunched stainless steel strips or 150 mm by 150 mm wire mesh. A coat of bituminous binder is applied over the base and the cable to prevent them from floating when the top layer is applied. The layer of asphalt over the cable should be 40 mm to 75 mm thick ([Figure 6](#)).

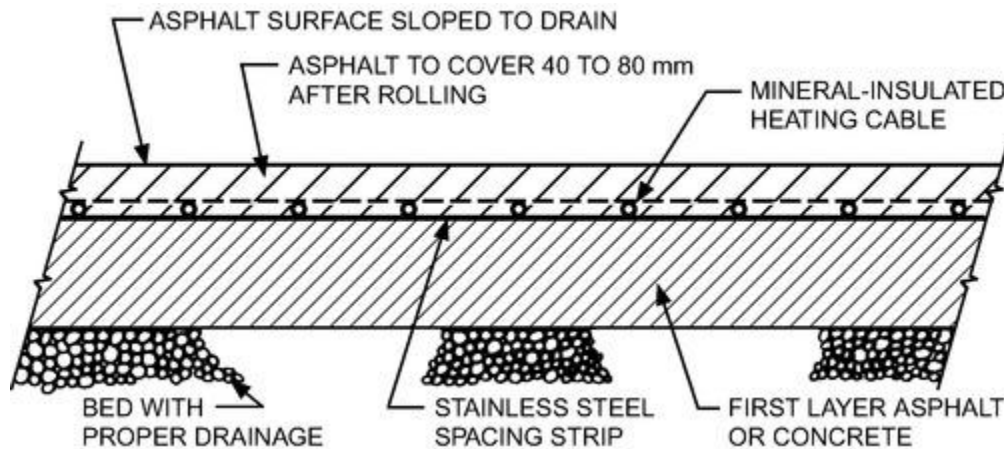


Figure 6. Typical Section, Mineral-Insulated Heating Cable in Asphalt (Potter 1967—ASHRAE Journal)

Testing. Mineral-insulated heating cables should be thoroughly tested before, during, and after installation to ensure they have not been damaged either in transit or during installation.

Because MgO insulation is hygroscopic, damage to the cable sheath is easily detectable with a 500 V field megohmmeter. Cable insulation resistance should be measured on arrival of the cable. Cable with insulation resistance of less than 20 MΩ should not be used. Cable that shows a marked loss of insulation resistance after installation should be investigated for damage. Cable should also be checked for electrical continuity.

Self-Regulating Cable

Self-regulating heating cables consist of two parallel conductors embedded in a heating core made of conductive polymer. These cables automatically adjust their power output to compensate for local temperature changes. Heat is generated as electric current passes through the core between the conductors. As the slab temperature drops, the number of electrical paths increases, and more heat is produced. Conversely, as the slab temperature rises, the core has fewer electrical paths, and less heat is produced.

Power output of self-regulating cables may be specified as watts per unit length at a particular temperature or in terms of snow-melting performance at a given cable spacing. In typical slab-on-grade applications, adequate performance may be achieved with cables spaced up to 300 mm apart. Narrower cable spacings may be required to achieve the desired snow-melting performance. The parallel construction of the self-regulating cable allows it to be cut to length in the field without affecting the rated power output.

Layout. For uniform heating, the heating cable should be arranged in a serpentine pattern that covers the area with 300 mm on-center spacing (or alternative spacing determined for the design). The heating cable should not be routed closer than 100 mm to the edge of the slab, drains, anchors, or other material in the concrete.

Crossing expansion, control, or other slab joints should be avoided. Self-regulating heating cables may be crossed or overlapped as necessary. Because the cables limit power output locally, they will not burn out.

Both ends of the cable should terminate in an aboveground weatherproof junction box. Junction boxes installed at grade level are susceptible to water ingress. An allowance of heating cable should be provided at each end for termination.

The maximum circuit length published by the manufacturer for the cable type should be respected to prevent tripping of circuit breakers. Use ground fault circuit protection as required by national and local electrical codes.

Installation. [Figure 7](#) shows a typical self-regulating cable installation. The procedure for installing a self-regulating system is as follows:

1. Hold a project coordination meeting to discuss the role of each trade and contractor. Good coordination helps ensure a successful installation.
2. Attach the heating cable to the concrete reinforcing steel or wire mesh using plastic cable ties at approximately 300 mm intervals. Reinforcing steel or wire mesh is necessary to ensure that the slab is structurally sound and that the heating cable is installed at the design depth.

3. Test the insulation resistance of the heating cable using a 2500 V dc megohmmeter connected between the braid and the two bus wires. Readings of less than 20 M Ω indicate cable jacket damage. Replace or repair damaged cable sections before the slab is poured.
4. Pour the concrete, typically in one layer. Take precautions to protect the cable during the pour. Do not strike the heating cable with sharp tools or walk on it during the pour.
5. Terminate one end of the heating cable to the power wires, and seal the other end using connection components provided by the manufacturer.

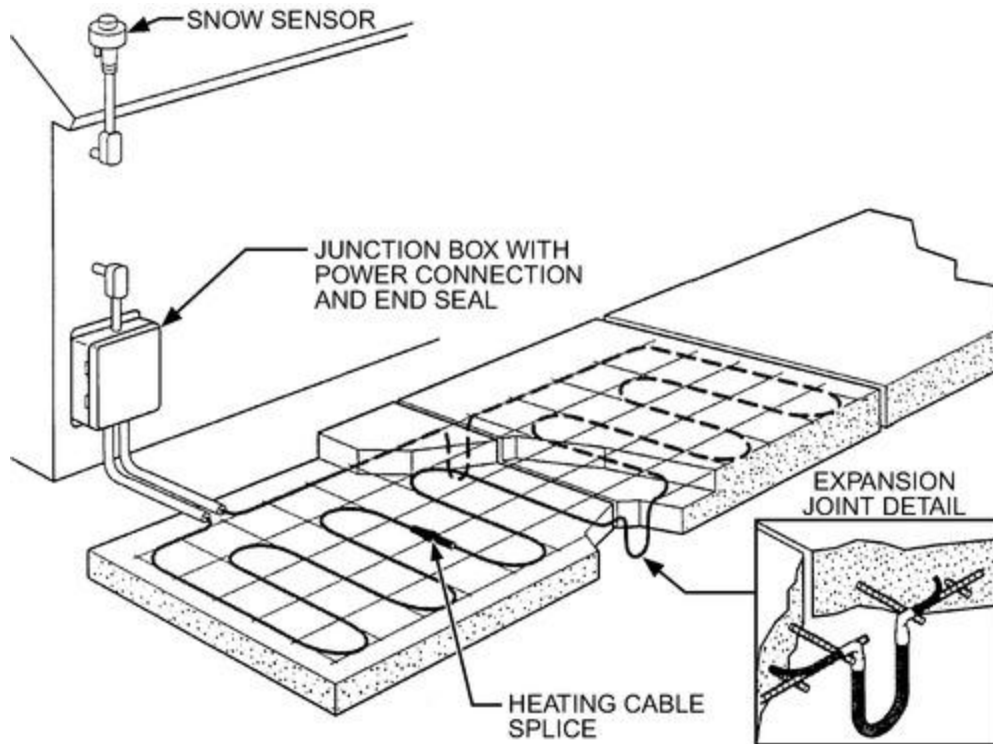


Figure 7. Typical Self-Regulating Cable Installation

Constant-Wattage Systems

In a constant-wattage system, the resistance elements may consist of a length of copper wire or alloy with a given amount of resistance. When energized, these elements produce the required amount of heat. Witsken (1965) describes this system in further detail.

Elements are either solid-strand conductors or conductors wrapped in a spiral around a nonconducting fibrous material. Both types are covered with a layer of insulation such as PVC or silicone rubber.

The heat-generating portion of an element is the conductive core. The resistance is specified in ohms per linear metre of core. Alternately, a manufacturer may specify the wire in terms of watts per metre of core, where the power is a function of the resistance of the core, the applied voltage, and the total length of core. As with MI cable, the power output of constant-wattage cable does not change with temperature.

Considerations in the selection of insulating materials for heating elements are power density, chemical inertness, application, and end use. Polyvinyl chloride is the least expensive insulation and is widely used because it is inert to oils, hydrocarbons, and alkalis. An outer covering of nylon is often added to increase its physical strength and to protect it from abrasion. The linear power density of embedded PVC is limited to 16 W/m. Silicone rubber is not inert to oils or hydrocarbons. It requires an additional covering (metal braid, conduit, or fiberglass braid) for protection. This material can dissipate heat of up to 30 W/m.

Lead can be used to encase resistance elements insulated with glass fiber. The lead sheath is then covered with a vinyl material. Output is limited to approximately 30 W/m by the PVC jacket.

Polytetrafluoroethylene (PTFE) has good physical and electrical properties and can be used at temperatures up to 260°C.

Low-power-density (less than 30 W/m) resistance wires may be attached to plastic or fiber mesh to form a mat unit. Prefabricated factory-assembled mats are available in a variety of watt densities for embedding in specified paving materials to match desired snow-melting capacities. Mats of lengths up to 18 m are available for installation in asphalt sidewalks and driveways.

Preassembled heating mats of appropriate widths are also available for **stair steps**. Heating mats are seldom made larger than 5.6 m², because larger ones are more difficult to install, both mechanically and electrically. With a series of

cuts, in the plastic or fiber mesh heating mats can be tailored to follow contours of curves and fit around objects, as shown in [Figure 8](#). Extreme care should be exercised to prevent damage to the heater wire (or lead) insulation during this operation.

Mats should be installed 40 to 75 mm below the finished surface of asphalt or concrete. Installing mats deeper decreases the snow-melting efficiency. Only mats that can withstand hot-asphalt compaction should be used for asphalt paving.

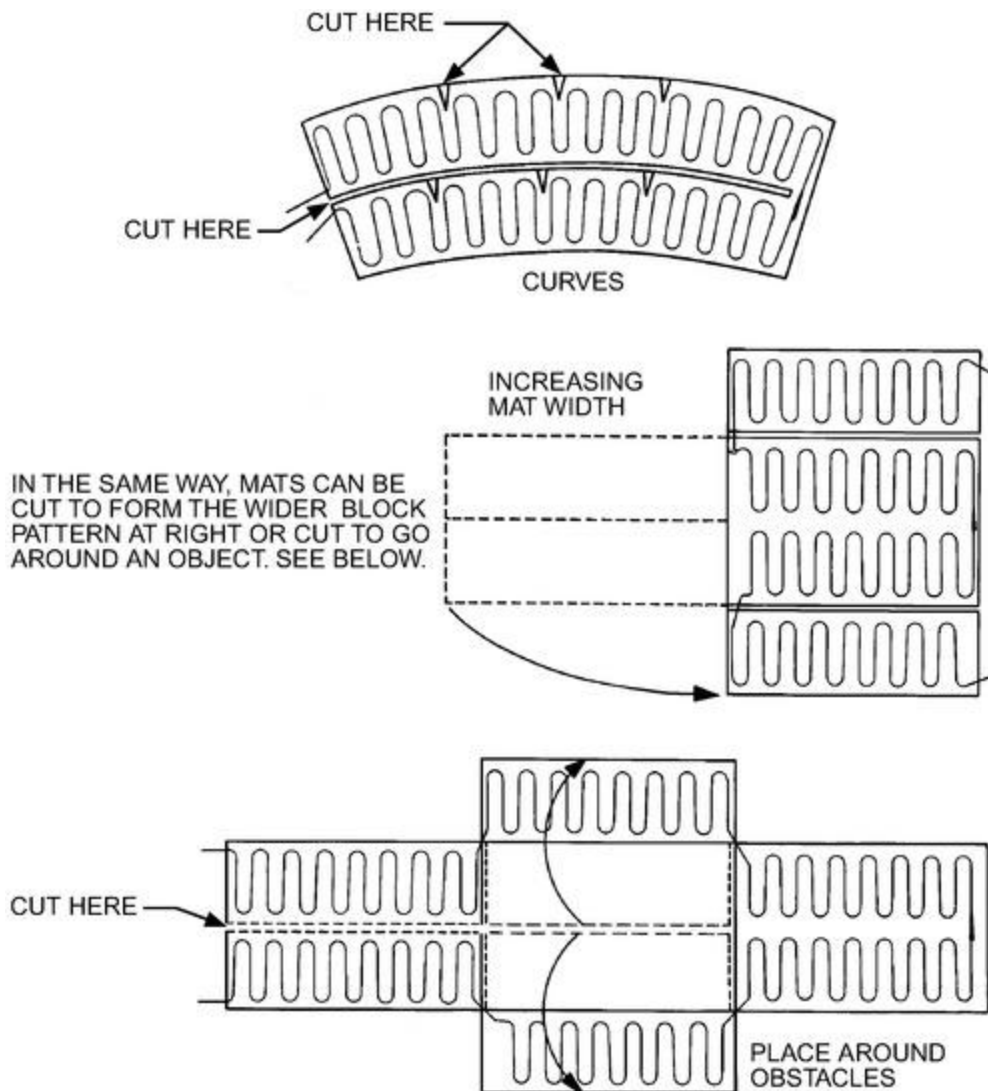


Figure 8. Shaping Heating Mats Around Curves and Obstacles

Layout. Heating wires should be long enough to fit between the concrete slab dummy groove control or construction joints. Because concrete forms may be inaccurate, 50 to 100 mm of clearance should be allowed between the edge of the concrete and the heating wire. Approximately 100 mm should be allowed between adjacent heating wires at the control or construction joints.

For asphalt, the longest wire or largest heating mat that can be used on straight runs should be selected. The mats must be placed at least 300 mm in from the slab edge. Adjacent mats must not overlap. Junction boxes should be located so that each accommodates the maximum number of mats. Wiring must conform to requirements of the *NEC* (NFPA *Standard 70*). It is best to position junction boxes adjacent to or above the slab.

Installation

General

1. Check the wire or heating mats with an ohmmeter before, during, and after installation.
2. Temporarily lay the mats in position and install conduit feeders and junction boxes. Leave enough slack in the lead wires to permit temporary removal of the mats during the first pour. Carefully ground all leads using the grounding braids provided.
3. Secure all splices with approved crimped connectors or set screw clamps. Tape all of the power splices with plastic tape to make them waterproof. All junction boxes, fittings, and snug bushings must be approved for this class of

application. The entire installation must be completely waterproof to ensure trouble-free operation.

In Concrete

1. Pour and finish each slab area between the expansion joints individually. Pour the base slab and rough level to within 40 to 50 mm of the desired finish level. Place the mats in position and check for damage.
2. Pour the top slab over the mats while the rough slab is still wet, and cover the mats to a depth of at least 40 mm, but not more than 50 mm.
3. Do not walk on the mats or strike them with shovels or other tools.
4. Except for brief testing, do not energize the mats until the concrete is completely cured.

In Asphalt

1. Pour and level the base course. If units are to be installed on an existing asphalt surface, clean it thoroughly.
2. Apply a bituminous binder course to the lower base, install the mats, and apply a second binder coating over the mats. The finish topping over the mats should be applied in a continuous pour to a depth of 30 to 40 mm. *Note:* Do not dump a large mass of hot asphalt on the mats because the heat could damage the insulation.
3. Check all circuits with an ohmmeter to be sure that no damage occurred during the installation.
4. Do not energize the system until the asphalt has completely hardened.

Infrared Snow-Melting Systems

Although overhead infrared systems can be designed specifically for snow-melting and freeze protection, they are usually installed for additional features they offer. Infrared systems provide comfort heating, which is particularly useful at entrances of plants, office buildings, and hospitals or on loading docks. Infrared lamps can improve a facility's security, safety, and appearance. These additional benefits may justify the somewhat higher cost of infrared systems.

Infrared fixtures can be installed under entrance canopies, along building facades, and on freestanding poles. Approved equipment is available for recessed, surface, and pendant mounting.

Infrared Fixture Layout. The same infrared fixtures used for comfort heating installations (as described in [Chapter 16 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#)) can be used for snow-melting systems. The major differences are in the orientation of the target area: whereas in comfort applications, the *vertical* surfaces of the human body constitute the target of irradiation, in snow-melting applications, a *horizontal* surface is targeted. When snow melting is the primary design concern, fixtures with narrow beam patterns confine the radiant energy within the target area for more efficient operation. Asymmetric reflector fixtures, which aim the thermal radiation primarily to one side of the fixture centerline, are often used near the periphery of the target area.

Infrared fixtures usually have a longer energy pattern parallel to the long dimension of the fixture than at right angles to it (Frier 1965). Therefore, fixtures should be mounted in a row parallel to the longest dimension of the area. If the target area is 2.4 m or more in width, it is best to locate the fixtures in two or more parallel rows. This arrangement also provides better comfort heating because radiation is directed across the target area from both sides at a more favorable incident angle.

Radiation Spill. An ideal energy distribution is uniform throughout the snow-melting target area at a density equal to the design requirement. The design of heating fixture reflectors determines the percentage of the total fixture radiant output scattered outside the target area design pattern.

Even the best-controlled beam fixtures do not produce a completely sharp cutoff at the beam edges. Therefore, if uniform distribution is maintained for the full width of the area, a considerable amount of radiant energy falls outside the target area. For this reason, infrared snow-melting systems are designed so that the power density on the slab begins to decrease near the edge of the area (Frier 1964). This design procedure minimizes stray radiant energy losses.

[Figure 9](#) shows the power densities obtained in a sample snow-melting problem (Frier 1965). The sample design average is 480 W/m². It is apparent that the incident power density is above the design average value at the center of the target area and below average at the periphery. [Figure 9](#) shows how the power density and distribution in the snow-melting area depend on the number, wattage, beam pattern, and mounting height of the heaters, and on their position relative to the slab (Frier 1964).

INTENSITY ON PAVEMENT FROM FOUR INFRARED FIXTURES, W/m ²														
158	172	213	255	274	296	304	301	304	296	274	255	213	172	158
255	267	309	341	384	411	414	424	414	411	384	341	309	267	255
277	341	404	460	499	532	562	571	562	532	499	460	404	341	277
304	369	461	503	551	600	630	678	630	600	551	503	461	369	304
304	369	461	503	551	600	630	678	630	600	551	503	461	369	304
277	341	404	460	499	532	562	571	562	532	499	460	404	341	277
255	267	309	341	384	411	414	424	414	411	384	341	309	267	255
158	172	213	255	274	296	304	301	304	296	274	255	213	172	158

Figure 9. Typical Power Density Distribution for Infrared Snow-Melting System 2.4 by 4.6 m target area, four single-element quartz lamps located 3 m above floor (Potter 1967).

With distributions similar to the one in [Figure 9](#), snow begins to collect at the edges of the area as the energy requirements for snow melting approach or exceed system capacity. As snowfall lessens, the snow at the edges of the area and possibly beyond is then melted if the system continues to operate.

Target Area Power Density. Theoretical target area power densities for snow melting with infrared systems are the same as those for commercial applications of constant-wattage systems except that back and edge heat losses are smaller. However, note that theoretical density values are for radiation incident on the slab surface, not that emitted from the lamps. Merely multiplying the recommended snow-melting power density by the slab area to obtain the total power input for the system does not result in good performance. Experience has shown that multiplying this product by a correction factor of 1.6 gives a more realistic figure for the total required power input. The resulting wattage compensates not only for the radiant inefficiency involved, but also for the radiation falling outside the target area. For small areas, or when the fixture mounting height exceeds 5 m, the multiplier can be as large as 2.0; large areas with sides of approximately equal length can have a multiplier of about 1.4.

The point-by-point method is the best way to calculate the fixture requirements for an installation. This method involves dividing the target area into 1 m squares and adding the radiant energy from each infrared fixture incident on each square ([Figure 9](#)). The radiant energy distribution of a given infrared fixture can be obtained from the equipment manufacturer and should be followed for that fixture size and placement.

With infrared energy, the target area can be preheated to snow-melting temperatures in 20 to 30 min, unless the air temperature is well below -7°C or wind velocity is high (Frier 1965). This short warm-up time makes it unnecessary to turn on the system before snow begins to fall. The equipment can be turned on either manually or with a snow detector. A timer is sometimes used to turn the system off 4 to 6 h after snow stops falling, allowing time for the slab to dry completely.

If snow is allowed to accumulate before the infrared system is turned on, there will be a delay in clearing the slab, as with embedded hydronic or electric systems. Because infrared energy is absorbed in the top layer of snow rather than by the slab surface, the time needed depends on snow depth and on atmospheric conditions. Generally, a system that maintains a clear slab by melting 25 mm of snow per hour as it falls requires 1 h to clear 25 mm of accumulated snow under the same conditions.

To ensure maximum efficiency, fixtures should be cleaned at least once a year, preferably at the beginning of the winter season. Other maintenance requirements are minimal.

Snow Melting in Gutters and Downspouts

Electrical heating cables are used to prevent heavy snow and ice accumulation on roof overhangs and to prevent ice dams from forming in gutters and downspouts (Lawrie 1966). [Figure 10](#) shows a typical cable layout for protecting a roof edge and downspout. Cable for this purpose is generally rated at approximately 20 to 50 W/m, and about 2.5 m of wire is installed per linear metre of roof edge. One metre of heated wire per linear metre of gutter or downspout is usually adequate.

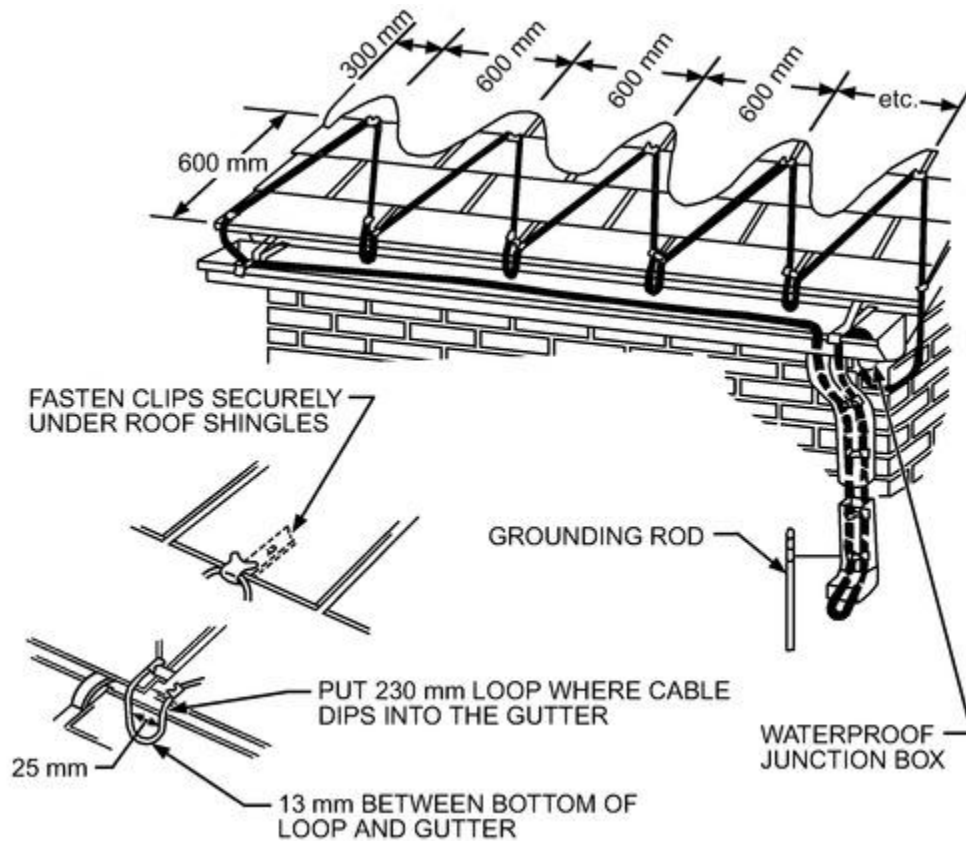


Figure 10. Typical Insulated Wire Layout to Protect Roof Edge and Downspout

If the roof edge or gutters (or both) are heated, downspouts that carry away melted snow and ice must also be heated. A heated length of cable (weighted, if necessary) is dropped inside the downspout to the bottom, even if it is underground.

Lead wires should be spliced or plugged into the main power line in a waterproof junction box, and a ground wire should be installed from the downspout or gutter. Ground fault circuit protection is required per the *NEC* (NFPA *Standard 70*).

The system can be controlled with a moisture/temperature controller, ambient thermostat, or manual control. The moisture/temperature controller is the most energy efficient. If manual control is used, a protective thermostat should also be used to prevent system operation at ambient temperatures above 5°C.

5. CONTROL

Automated Controls

Manual operation, where an operator must activate and deactivate the system when snow falls, does not comply with current energy standards such as ASHRAE *Standard 90.1* and is not recommended. ASHRAE *Standard 90.1-2016* requires that snow and ice melting systems include automatic controls that can shut off the systems when the pavement temperature is above 10°C and no precipitation is falling, and an automatic or manual control that allows shutoff when the outdoor temperature is above 4.4°C so that the potential for snow or ice accumulation is negligible.

In addition, hydronic systems require fluid temperature control for safety and for component longevity. Slab stress and temperature limits of the heat transfer fluid, pipe components, and fluid heater need to be considered. Some nonmetallic pipe materials should not be subjected to temperatures above 60°C. If the primary control fails, a secondary fluid temperature sensor should deactivate the snow-melting system and possibly activate an alarm.

Control Selection

Automatic controls provide satisfactory operation by activating the system when light snow starts, allowing adequate warm-up before heavy snowfall develops. Automatic deactivation reduces operating costs.

Snow Detectors. Snow detectors monitor precipitation and temperature. They allow operation only when snow is present and may incorporate a delay-off timer. Snow detectors located in the heated area activate the snow-melting system when precipitation (snow) occurs at a temperature below the preset slab temperature (usually 4°C). Another type of snow detector is mounted above ground, adjacent to the heated area, without cutting into the existing system; however, it does not detect tracked or drifting snow. Both types of sensors should be located so that they are not affected by overhangs, trees, blown snow, or other local conditions.

Slab Temperature Sensor. To limit energy waste during normal and light snow conditions, a remote temperature sensor is commonly installed midway between two pipes or cables in the slab; the set point is adjusted between 5 and 15°C. Thus, during mild-weather snow conditions, the system is automatically modulated or cycled on and off to keep the slab temperature (at the sensor) at set point.

Outdoor Thermostat. The control system may include an outdoor thermostat that deactivates the system when the outdoor ambient temperature rises above 2 to 5°C as automatic protection against accidental operation in summer or mild weather.

For optimum operating convenience and minimum operating cost, all of the preceding controls should be incorporated in the snow-melting system.

Operating Cost

To evaluate operating cost during idling or melting, use the annual output data from [Table 3](#). Idling and melting data are based on slab surface temperature control at 0°C during idling, which requires a slab temperature sensor. Without a slab temperature sensor, operating costs will be substantially higher.

6. FREEZE PROTECTION SYSTEMS

If the slab surface temperature is below 0°C, any water film present on that surface freezes. Water may be present because of accidental spillage, runoff from a nearby source, or premature shutoff of snow-melting operation after precipitation ends but before the surface dries (temperature usually drops rapidly after snow). Therefore, for cases with $A_r < 1$, if the system is shut off too soon, the remaining snow and fluid film on the surface may freeze (Adlam 1950). As previously discussed, idling keeps the slab surface from freezing by maintaining a surface temperature of at least 0.5°C and also reduces the required start-up surface heat flux for snow-melting.

To calculate surface heat flux during idling, the surface may be assumed to be free of snow, covered with a film of water. Unless there is a constant influx of water from the vicinity, the evaporation heat flux of that film may be ignored and the surface may be assumed to be uncovered because the insulation effect of the water film is negligible. In this case, surface heat flux can be calculated by [Equation \(5\)](#).

The surface is free of snow; therefore, [Equation \(5\)](#) approximates the surface heat flux. The mean radiant temperature that appears in [Equation \(5\)](#) is evaluated using [Equations \(8\)](#), [\(9\)](#), and [\(10\)](#). The fraction F_{sc} of radiation between the surface and the clouds is equal to the cloud cover fraction in the meteorological data.

Chapman (1952) also proposed the following equation to determine the required surface heat flux for idling q_i in W/m^2 , if the mean ambient air temperature t_m during freezing is known:

$$q_i = (0.953V + 18.74)(0^\circ\text{C} - t_m) \quad (32)$$

A slab surface temperature monitor may control the freeze protection system. Whenever the slab surface temperature drops below 0.56°C, the system activates. However, idling the slab during the entire winter, as given in [Table 3](#), may be too costly, and unnecessary if the main purpose is to reduce high snow-melting surface heat flux at start-up. For example, the annual energy requirement for idling is 45 times more than that for snow-melting in Chicago, $A_r = 0.5$. Therefore, a cost-effective operation may require starting the system to idle only before an anticipated snow. The lead time may be determined by the thermal mass of the slab, local meteorological conditions, idling and start-up snow-melting heat fluxes, and energy cost. Depending on local weather conditions, idling may also be started automatically when prevailing atmospheric conditions make snowfall likely.

Freeze protection systems may also be used in a variety of applications. For example, the foundation of a cold-storage warehouse may be protected from heaving by using a heated floor slab similar to a snow-melting system. The slab must be insulated at the top as well as the back and edges. Top insulation prevents the heated slab from interfering with the space-cooling process in the warehouse. Edge insulation must penetrate below the freezing line. Generally, design heat flux is taken to be between 16 and 32 W/m^2 and the system is operated year-round.

Another freeze protection application is pipe tracing, where a pipe or conduit exposed to the atmosphere is protected against freezing of the fluid within. If a highly viscous fluid is transported, the desired pipe (fluid) temperature may need to be higher than the fluid-freezing temperature to maintain the viscosity required for fluid flow. [Figure 11](#) shows a typical application in which small "tracer" pipes or electrical heating cables are banded along the lower surface of the pipe (Kenny 1999). In a hydronic tracing system, hot fluid or steam may be used. In electric systems, heating cable or mats may be used. Pipe and the tracing elements are covered with thermal insulating material such as fiberglass, polyurethane, calcium silicate, or cellular glass. Sometimes multiple insulation layers may be used. Insulating material must be protected from rain and other external conditions by a weather barrier. Pipe-tracing heat load per unit pipe length q_k is given by the following formula (IEEE 1983):

(33)

$$q_k = \frac{(t_p - t_a)}{\frac{1}{\pi D_i h_i} + \frac{\ln(D_o/D_i)}{2\pi k_1} + \frac{\ln(D_3/D_o)}{2\pi k_2} + \frac{1}{\pi D_3 h_{co}} + \frac{1}{\pi D_3 h_o}}$$

where

q_k = pipe tracing heat load per unit pipe length, W/m

t_p = desired pipe temperature, °C

t_a = design ambient temperature, °C

D_i = inside diameter of inner insulation layer (and outer diameter of pipe), m

D_o = outside diameter of inner insulation layer (and inside diameter of outer insulation layer, if present), m

D_3 = outside diameter of outer insulation layer (if present), m. Otherwise, the expression $\ln(D_3/D_o)/2\pi k_2$ in [Equation \(24\)](#) is dropped and D_3 in the last two terms in the denominator of the same equation is replaced by D_o .

k_1 = thermal conductance of inner insulation layer, W/(m · K) (evaluated at its average operating temperature)

k_2 = thermal conductance of outer insulation layer, if present, W/(m · K) (evaluated at its average operating temperature)

h_i = thermal convection coefficient of air film between pipe and inner insulation surface, W/(m · K).

h_{co} = thermal convection coefficient of air between outer insulation surface and weather barrier (if present), W/(m · K)

h_o = combined surface heat transfer coefficient for radiation and convection between weather barrier, if present (otherwise, the outer insulation layer), to ambient, W/(m · K). Values for h_o may be calculated from information in [Chapter 4 of the 2021 ASHRAE Handbook—Fundamentals](#) and [Chapter 16 of the 2020 ASHRAE Handbook—HVAC Systems and Equipment](#).

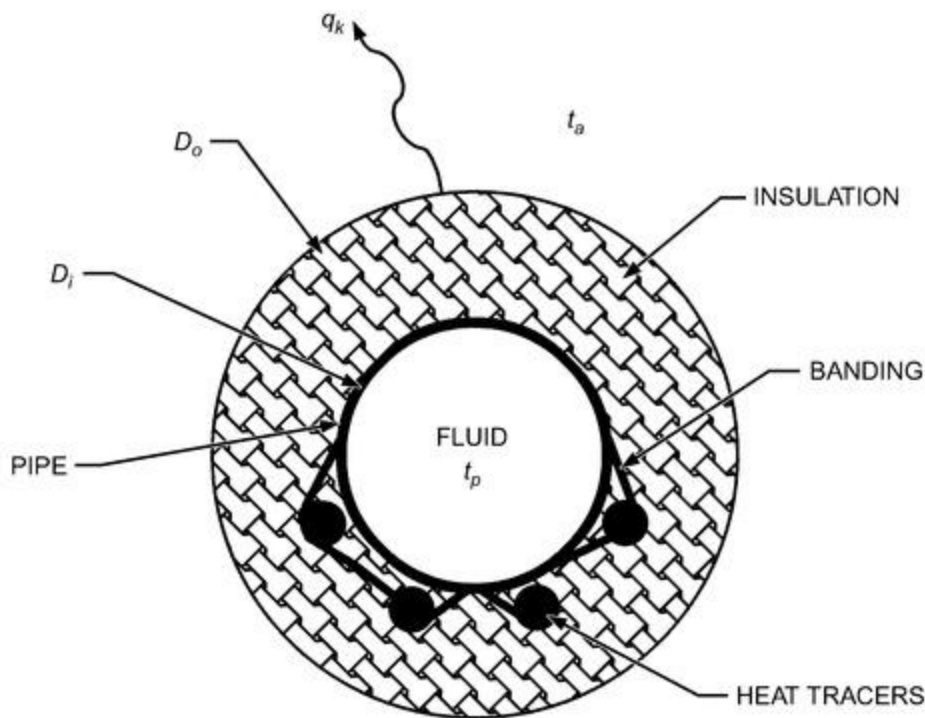


Figure 11. Typical Heat Tracing Arrangement (Hydronic or Electric)

An appropriate pipe-tracing system is selected to satisfy q_k . For ease of product selection, some manufacturers offer design software or simple charts and graphs of heat losses for various pipe temperatures and insulation configurations. Safety factors are usually added by explicitly increasing the calculated heat load, by decreasing the design ambient temperature, or by conservative selection of k and h values. Pipe- or conduit-tracing heat loads can be more complex because of the heat sinks that penetrate the insulation surface(s); they often require a complex analysis to determine total heat loss, so a heat trace supplier should be consulted.

Steam Pipe-Tracing Systems

Steam tracing involves circulating steam in a pipe or tube that runs parallel to the pipe being traced. As the steam recondenses, it releases its latent heat and transfers it into the traced pipe. A typical steam pipe-tracing system is

shown in [Figure 12](#).

Steam systems have relatively high installed costs, particularly if an appropriately sized boiler and header system is not already in place. Steam is widely used for industrial applications, and the design is familiar to pipe installers. Steam is well suited for applications that require a high heat flux, but often is not as efficient for lower-heat-flux applications such as pipe freeze protection.

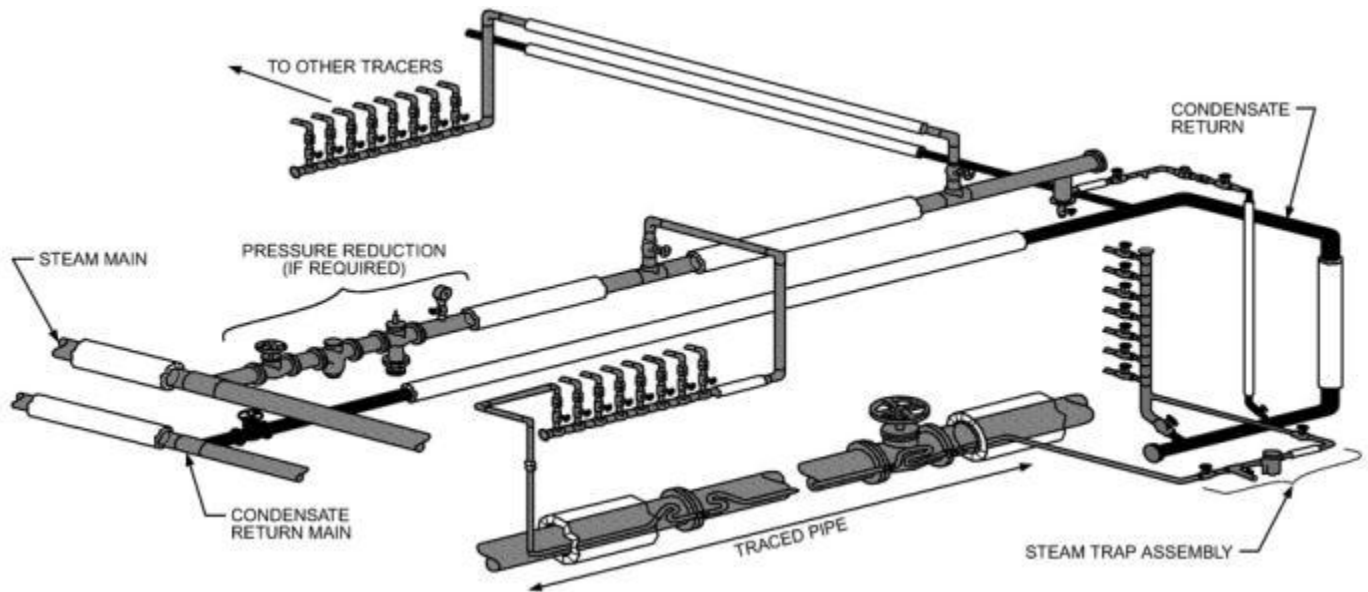


Figure 12. Typical Pipe-Tracing System with Steam System

Electric Pipe-Tracing Systems

Electric pipe-tracing systems involve placing (tracing) an electrical resistance wire parallel to the pipe or tube being traced. This electric heater provides heat to the pipe to balance heat loss to the lower-ambient surrounding. A typical electric system is shown in [Figure 13](#).

Types of electric heating cables include the following:

- **Self-regulating heating cables** consist of two parallel conductors embedded in a heating core made of conductive polymers. These cables automatically adjust their power output to compensate for local temperature changes. Heat is generated as electric current passes through the conductive core between the conductors. As the pipe temperature drops, the number of electrical paths increases, and more heat is produced. Power output of self-regulating heating cables is specified as watts per unit length at a particular temperature. The self-regulating feature makes the heating cables more energy efficient, because they change their power output based on the need at that point in the pipe. Because they are parallel, they can be cut to length and spliced in the field. Disadvantages are that they are often more expensive and have shorter maximum run lengths because of inrush current.
- **Series heating cables** are one or two copper, copper alloy, or nichrome elements surrounded by a polymer insulating jacket. Power outputs of series cables are specified in watts per unit length. These heating cables are usually inexpensive. Their main disadvantage is that the length cannot be adjusted without changing the power output.
- **Mineral-insulated (MI) heating cables** are series heating cables composed of a magnesium oxide (MgO)-filled, die-drawn cable with one or two copper or copper alloy conductors and a seamless copper or stainless steel alloy sheath. Power output of an MI heating cable is specified in watts per unit length. MI heating cables are rugged and can withstand high temperatures, but are not very flexible. They generally must be ordered in the size needed; splicing in the field is craft-sensitive.
- **Zone heaters** consist of two insulated copper bus wires wrapped with a small-gage (38 to 41 AWG) nichrome heating wire, covered with polymer insulation. The heating wire is connected to alternate bus wires at nodes spaced 0.3 to 1.2 m apart. Current flowing between the bus wires on the heating element generates heat. Power output of a zone heating cable is specified in watts per unit length. Zone heaters are parallel heaters, and thus can be cut to length and spliced in the field. Care must be used to prevent the thin heating wire from being damaged.

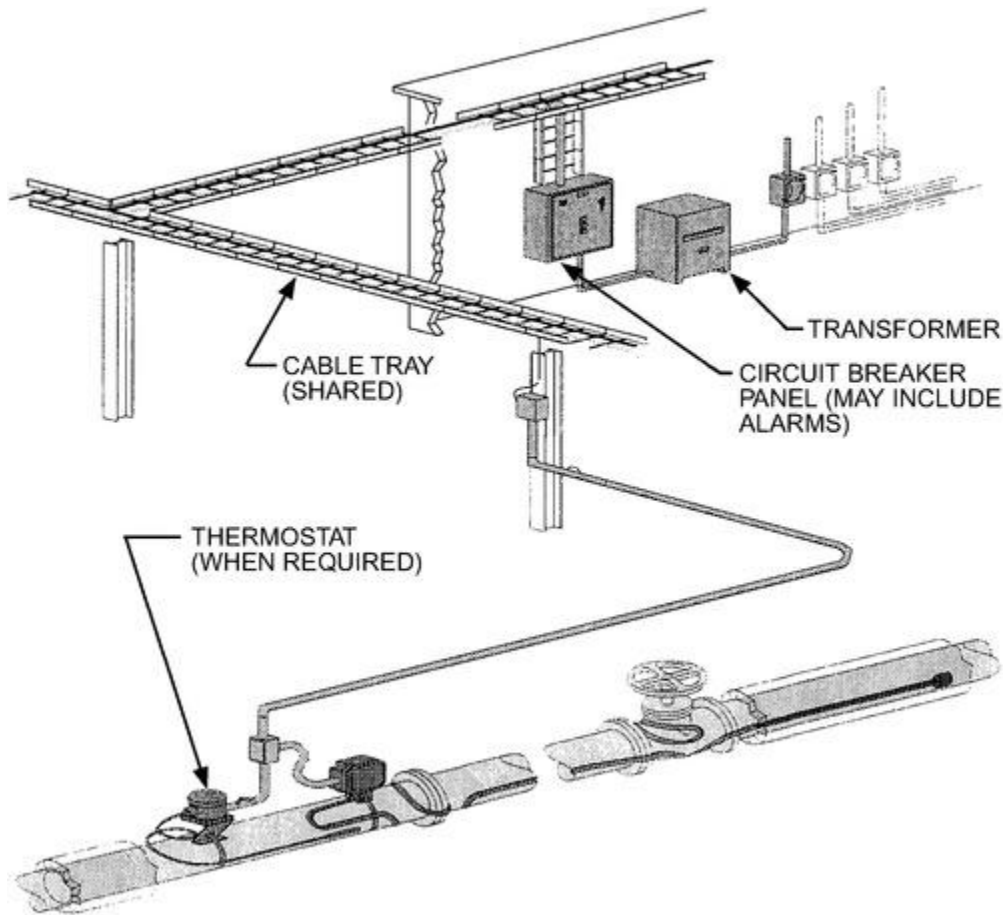


Figure 13. Typical Pipe Tracing with Electric System

Control

The pipe-tracing system is designed to replace pipe heat loss in the worst case (at the lowest ambient temperature). Most of the time, when the temperature is above the lowest ambient temperature, the heat trace system will produce more heat than is required. To conserve energy, or to prevent the pipe from getting too warm, a control system is usually added.

Approaches to basic control include the following:

- **None.** Sometimes heat trace can be allowed to remain energized, most commonly with short lengths of self-regulating electric heat trace or in cases where the ambient temperature does not change (such as a pipe inside a cold-storage area). This is the least efficient control method from an energy usage standpoint, but the easiest to design. A slight variation on this is a manual switch to disconnect power when not needed, using a switch or circuit breaker.
- **Ambient thermostat.** This involves reading the air temperature and activating the system when the air temperature approaches freezing (often at 4°C). This ensures that the system is energized when the pipe could freeze and de-energized when it is warm. This system is often the best compromise between energy efficiency and ease of design.
- **Pipe-sensing thermostat.** This involves reading the pipe temperature and activating the heat trace system when the pipe temperature approaches freezing (often at 4°C). This is the most energy-efficient system, but is more complex to design so that the sensor reading is representative of all areas of the pipe. Always put the control sensor on the smallest pipe and at the coldest anticipated location.

REFERENCES

ASHRAE members can access *ASHRAE Journal* articles and ASHRAE research project final reports at technologyportal.ashrae.org. Articles and reports are also available for purchase by nonmembers in the online ASHRAE Bookstore at www.ashrae.org/bookstore.

ACI. 2014. *Guide to thermal properties of concrete and masonry systems*. American Concrete Institute, Farmington Hills, MI.

Adlam, T.N. 1950. *Snow melting*. Industrial Press, New York; University Microfilms, Ann Arbor, MI.

- Brown, B. 1999. Klamath Falls geothermal district heating systems. *GHC Bulletin* (March):5-9.
- Chapman, W.P. 1952. Design of snow melting systems. *Heating and Ventilating* (April):95 and (November):88.
- Chapman, W.P. 1955. Are thermal stresses a problem in snow melting systems? *Heating, Piping and Air Conditioning* (June):92 and (August): 104.
- Chapman, W.P. 1999. A review of snow melting system design. *ASHRAE Transactions* 105(1).
- COESA. 1976. *U.S. Standard Atmosphere 1976*. U.S. Committee on Extension to the Standard Atmosphere. U.S. Government Printing Office, Washington, D.C.
- Colliver, D.G., R.S. Gates, H. Zhang, T. Burks, and K.T. Priddy. 1998. Updating the tables of design weather conditions in the *ASHRAE Handbook—Fundamentals*. ASHRAE RP-890 *Final Report*.
- CSA. 2014. Concrete materials and methods of concrete construction: Test methods and standard practices for concrete. *Standard A23.14/A23.2-14*. Canadian Standards Association Group.
- Frier, J.P. 1964. Design requirements for infrared snow melting systems. *Illuminating Engineering* (October):686. Also discussion (December).
- Frier, J.P. 1965. Snow melting with infrared lamps. *Plant Engineering* (October):150.
- Gordon, P.B. 1950. Antifreeze protection for snow melting systems. *Heating, Piping and Air Conditioning Contractors National Association Official Bulletin* (February):21.
- IEEE. 1983. IEEE recommended practice for the testing, design, installation, and maintenance of electrical resistance heat-tracing for industrial applications. *IEEE Standard 515-1983*. Institute of Electrical and Electronics Engineers.
- Incropera, F.P., and D.P. DeWitt. 1996. *Introduction to heat transfer*, pp. 332-334. John Wiley & Sons, New York.
- Kenny, T.M. 1999. Effective steam tracing, *ASHRAE Journal* 41(1):42-44.
- Kilkis, I.B. 1994. Design of embedded snow-melting systems: Part 1, heat requirements—An overall assessment and recommendations; Part 2, heat transfer in the slab—A simplified model. *ASHRAE Transactions* 100(1):423-433, 434-441.
- Kilkis, I.B. 1995. An energy efficient design algorithm for snow-melting systems. *Proceedings of the International Conference ECOS '95*. Simulation and Environmental Impact of Energy Systems, ASME, NY.
- Kuehn, T.H., J.W. Ramsey, and J.L. Threlkeld. 1998. *Thermal environmental engineering*, 3rd ed. Prentice Hall, Upper Saddle River, NJ.
- Lawrie, R.J. 1966. Electric snow melting systems. *Electrical Construction and Maintenance* (March):110.
- NCDC. 1990. *Precipitation—Hourly cooperative TD-3240 documentation manual*. National Climatic Data Center, Asheville, NC.
- NCDC. 1993. Solar and meteorological surface observation network 1961-1990 (SAMSON), Version 1.0.
- NFPA. 1996. *National electrical code®*. ANSI/NFPA Standard 70-96. National Fire Protection Association, Quincy, MA.
- Potter, W.G. 1967. Electric snow melting systems. *ASHRAE Journal* 9(10): 35-44.
- Ramsey, J.W., H.D. Chiang, and R.J. Goldstein. 1982. A study of the incoming long-wave atmospheric radiation from a clear sky. *Journal of Applied Meteorology* 21:566-578.
- Ramsey, J.W., M.J. Hewett, T.H. Kuehn, and S.D. Petersen. 1999. Updated design guidelines for snow melting system. *ASHRAE Transactions* 105(1):1055-1065.
- Shirakawa, K., S. Kobayashi, S. Koyama, and M. Syuniji. 1985. Snow melting pavement with steel reinforced concrete. *Summimoto Research* 31.
- Spitler, J.D., S.J. Rees, X. Xia, and M. Chulliparambil. 2001. Development of a two-dimensional transient model of snow-melting systems and use of the model for analysis of design alternatives. ASHRAE Research Project RP-1090, *Final Report*.
- Spitler, J.D., S.J. Rees, and X. Xia. 2002. Transient analysis of snow-melting system performance. *ASHRAE Transactions* 108(2):406-425.
- Witsken, C.H. 1965. Snow melting with electric wire. *Plant Engineering* (September):129.

BIBLIOGRAPHY

- Chapman, W.P. 1955. Snow melting system hydraulics. *Air Conditioning, Heating and Ventilating* (November).
- Chapman, W.P. 1957. Calculating the heat requirements of a snow melting system. *Air Conditioning, Heating and Ventilating* (September through August).
- Chapman, W.P., and S. Katunich. 1956. Heat requirements of snow melting systems. *ASHAE Transactions* 62:359.
- Erickson, C.J. 1995. *Handbook of electrical heating for industry*. Institute of Electrical and Electronic Engineers.
- Hydronics Institute. 1994. *Snow melting calculation and installation guide*. Berkeley Heights, NJ.
- Mohinder, L.N. 2000. *Piping handbook*, 7th ed. McGraw-Hill, New York.
- NACE. 1978. *Basic corrosion course text* (October). National Association of Corrosion Engineers, Houston, TX.

The preparation of this chapter is assigned to TC 6.5, Radiant Heating and Cooling.